

technical data



Fan coil units

FWV - low wall unit

FWL - flexi type unit

FWM - concealed flexi type unit

FWD - duct unit

FWB - small duct unit

7

Fain coil units

"The present publication is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this publication to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage. In the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Daikin Europe N.V."



ISO14001 assures an effective environmental management system in order to help protect human health and the environment from potential impact of our activities, products and services and to assist in maintaining and improving the quality of the environment.




Daikin units comply with the European regulations that guarantee the safety of the product.



Daikin Europe N.V. is approved by LRQA for its Quality Management System in accordance with the ISO9001 standard. ISO9001 pertains to quality assurance regarding design, development, manufacturing as well as to services related to the product.



Daikin Europe N.V. participates in the Eurovent Certification Programme for Air Conditioners (AC), Liquid Chilling Packages (LCP) and Fan Coil units (FC); the certified data of certified models are listed in the Eurovent Directory.




DAIKIN EUROPE N.V.

Zandvoordestraat 300
B - 8400 Ostend Belgium
www.daikineurope.com



technical data

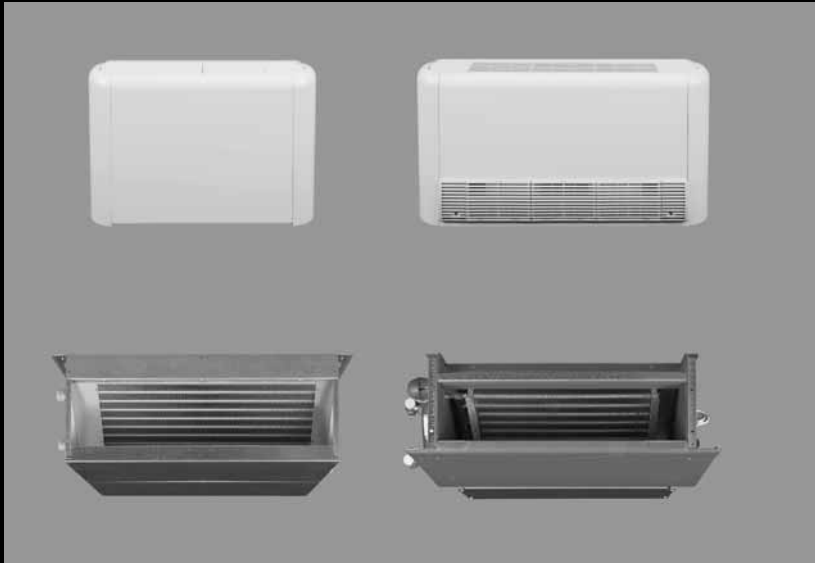

Fan coil units

FWV - low wall unit

FWL - flexi type unit

FWM - concealed flexi type unit


FWD - duct unit

FWB - small duct unit

Cooling only



Heating only



Heat pump





TABLE OF CONTENTS

FWV/FWL/FWM/FWD/FWB

1	Nomenclature	6
2	Features	7
3	Specifications	
	Technical specifications	8
	Electrical specifications	13
4	Power consumption in function of ESP and speed	
	FWV/FWL/FWM - 2-pipe series	14
	FWV/FWL/FWM - 4-pipe series	16
	FWD - 2-pipe series/4-pipe	18
	FWB	22
5	Capacity tables	
	FWV/FWL/FWM - 2-pipe series	23
	FWV/FWL/FWM - 4-pipe series	29
	FWD - 2-pipe/4-pipe series	35
	FWD - 2-pipe series	38
	FWD - 4-pipe series	40
	FWB - 2-pipe series	42
	FWB - Additional heat exchanger	46
6	Correction factors	
	Correction factors for cooling & heating capacities	48
	Glycol correction factors	51
	Capacity and absorption of electric heater	52
7	Water pressure drop	
	FWV/FWL/FWM	53
	FWD	54
	FWB	56
8	Operation range	
	FWV/FWL/FWM	59
	FWD	59
	FWB	59
9	Dimensional drawings	
	FWV/FWL	60
	FWM	61
	FWD	62
	FWB	63
10	Wiring diagrams	
	FWV/FWL/FWM	64
	FWD	65
	FWB	66
11	Sound power data	
	FWV/FWL/FWM	67
	FWD	69
	FWB	73
12	Installation	
	Controller	76
	Installation precautions	77
	Installation & service distance	83
13	Options	
	FWV/FWL/FWM	85
	FWD	87
	FWB	89





1 Nomenclature

1 Digit

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
F	W	V L M D B	0 1	0 1 2 3 4 6 8	A C	A	T F	N V	6	V	1 3	- E F G	- E M P Q R	- R S T
													Options	

Digit	Character	Description	Digit	Character	Description
1-2	FW	Water fancoil	13	-	Electric heater/Fan stop thermostat No heater / no fan stop thermostat
3	V	Vertical		E	Electric heater
	L	Flexi casing		F	Fan stop thermostat
	M	Flexi no casing	G	Electric heater/Fan stop thermostat	
	D	Duct			
B	Small duct				
4-5	01>18	Size	14	-	Controller No controller
6	A/C	Series		E	Electr. contr.
7	A	Minor model change		M	Electro mech. contr.
8	T F	Coil type Coil type: 2-pipe Coil type: 4-pipe		P	Power interface
			Q	P+E	
9	N V	Valves Without valves With ON/OFF valves	R	P+M	
			15	-	Water connection LL
R	RR				
S	RL				
T	LR				
10	6	Production location			
11-12	V1	Power supply 220-240V - 1 phase			
	V3	230V - 1 phase			



2 Features

- **Controllers are easy to read and operate!**

- 3 different controllers:
 - 2 electronic controllers (built-in or remote)
 - 1 electromechanical control (built-in)
- The control panel is consists of:
 - Fan speed selector (3 steps and auto)
 - Cool / Heat selector
 - Operational leds
 - Thermostat
- Numerous configurations possible
- Water probe and air sensor
- Auxiliary contacts

- **Fast and easy field set up, ready for use!**


- Quick fixing system for wall/ceiling mounting
- Pre-assembled 3-way/4-port ON/OFF valves are available
- Valve packages can be factory-mounted and are leak tested
- Quick electrical connections

- **Low maintenance and high efficiency**

- Quick removal of washable filter
- Removable grilles
- Only 4 screws to access the fan motor
- Easy access to control valves

- **Wide range of options**

- Easy to use controllers
- Electric heater
- Valve kit
- Additional one-row heat exchanger
- ..à and many others

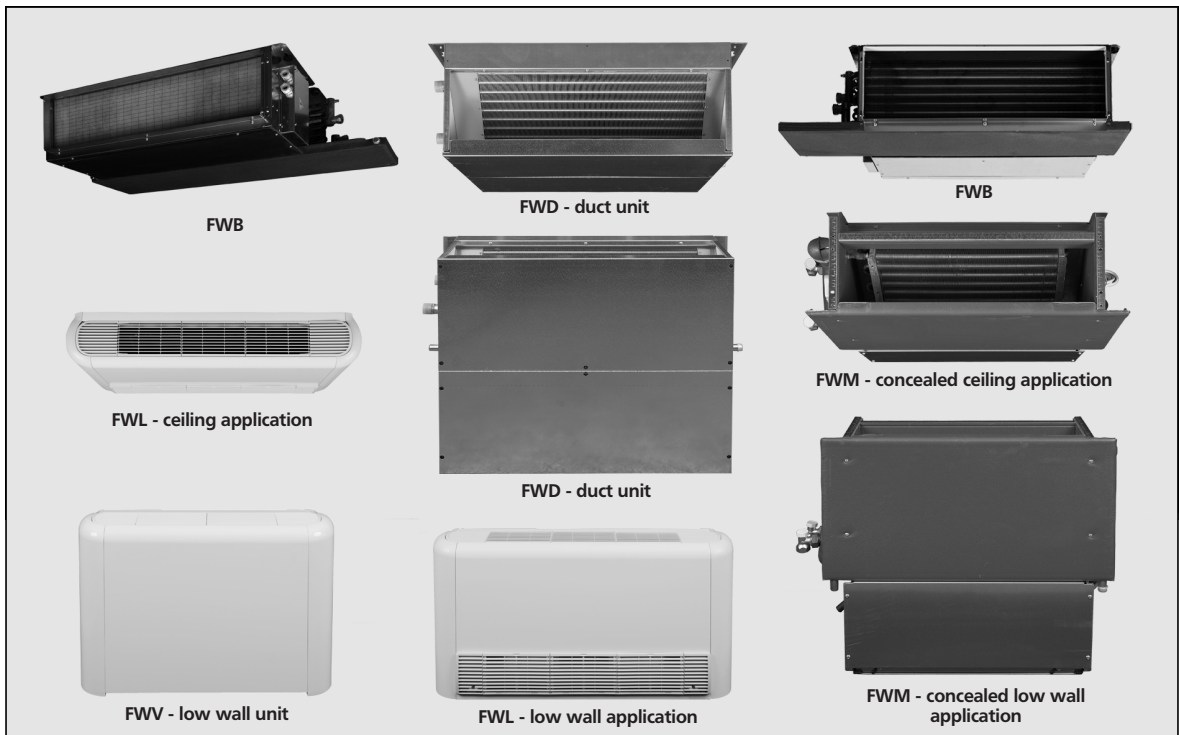



3 Specifications

3-1 Technical specifications

3-1-1 FWW-FWL-FWM - 2-pipe series

3-1

NOMINAL CAPACITY and NOMINAL INPUT										
MODEL			FW..01C**	FW..02C**	FW..03C**	FW..04C**	FW..06C**	FW..08C**	FW..10C**	
POWER INPUT		high	W	36	46	62	87	89	182	244
		medium	W	26	32	46	61	62	127	169
		low	W	21	21	30	41	42	86	109
COOLING CAPACITY (1)	Total capacity	high	kW	1.54	2.09	2.93	4.33	4.77	6.71	8.71
		medium	kW	1.24	1.81	2.38	3.27	3.87	5.27	6.78
		low	kW	1.04	1.45	1.76	2.51	3.17	3.97	4.49
	Sensible capacity	high	kW	1.20	1.51	2.11	3.15	3.65	4.91	6.38
		medium	kW	0.97	1.31	1.70	2.45	2.92	3.83	4.94
		low	kW	0.79	1.05	1.26	1.80	2.32	2.84	3.25
HEATING CAPACITY (2)		high	kW	2.14	2.79	3.81	5.63	6.36	7.83	11.10
		medium	kW	1.73	2.33	3.08	4.30	5.21	6.23	8.64
		low	kW	1.43	1.91	2.28	3.29	4.24	4.77	5.80

TECHNICAL SPECIFICATIONS										
MODEL			FW..01C**	FW..02C**	FW..03C**	FW..04C**	FW..06C**	FW..08C**	FW..10C**	
DIMENSIONS	FWW/FWL	mm	564x774x226		564x984x226	564x1,194x226	564x1,194x226	564x1,404x251		
	FWM	mm	535x584x224		535x794x224	535x1,004x224	535x1,004x224	535x1,214x249		
WEIGHT	FWW	kg	19	20	25	30	31	41	41	
	FWL	kg	20	21	27	32	33	44	44	
	FWM	kg	14	15	19	23	23	32	32	
MATERIAL	FWW/FWL/FWM	Plastic + sheet metal								
COLOUR		Plastic and metal RAL9010								
SOUND LEVEL	Sound power	high	dB(A)	47	52	50	55	59	61	66
		medium	dB(A)	39	44	44	48	52	54	58
		low	dB(A)	34	36	38	40	44	47	48
WATER FLOW	Cooling	l/h	265	359	504	745	820	1154	1498	
	Heating	l/h	265	359	504	745	820	1154	1498	
WATER PRESSURE DROP	Cooling	kPa	13	13	11	12	14	12	19	
	Heating	kPa	9	10	9	9	10	9	13	
FAN	Type	Centrifugal multi-blade, double suction								
	Air flow rate at 0 Pa ESP	high	m ³ /h	319	344	442	706	785	011	1393
		medium	m ³ /h	233	271	341	497	605	771	1022
		low	m ³ /h	178	211	241	361	470	570	642
Speed	3 steps: high, medium, low									
Qty	1 1 2 2 2 2 2 2									
MOTOR	Type	Closed induction, B class insulation, winding thermal cut-out								
HEAT EXCHANGER	Rows x stages x fin pitch	mm	2x10x1.8	3x10x1.6	3x10x1.6	3x10x1.8	3x10x1.6	3x12x2.1	3x12x2.1	
	Face area	m ²	0.086	0.086	0.138	0.191	0.191	0.292	0.292	
	Water volume	ℓ	0.5	0.7	1	1.4	1.4	2.1	2.1	
AIR FILTER	Plastic									
INSULATION MATERIAL	Class 1 self-extinguishing									
VIBRATION INSULATION	Rubber ring for fan motor									
PIPING CONNECTIONS	Water inlet/outlet	inch	1/2"	1/2"	1/2"	1/2"	1/2"	3/4"	3/4"	
	Drain FWW	mm	16							
	Drain FWM	mm	17							

4TW60011-1

NOTES

- 1 rating conditions cooling 2 pipe: air 27°C DB - 19°C WB - entering water 7°C - leaving water 12°C
- 2 rating conditions heating 2 pipe: air 20°C DB - entering water 50°C - water flow as in cooling mode

SYMBOLS

- ** : TN = 2-pipe, without valves
- TV = 2-pipe, with ON / OFF valves
- FN = 4-pipe, without valves



3 Specifications

3-1 Technical specifications

3-1-2 FWW-FWL-FWM - 4-pipe series

3

3-1

NOMINAL CAPACITY and NOMINAL INPUT										
MODEL			FW..01C**	FW..02C**	FW..03C**	FW..04C**	FW..06C**	FW..08C**	FW..10C**	
POWER INPUT		high	W	36	59	62	87	89	182	244
		medium	W	26	41	46	61	62	127	169
		low	W	21	27	30	41	42	86	109
COOLING CAPACITY (1)	Total capacity	high	kW	1.50	1.79	2.87	4.26	4.67	6.64	8.55
		medium	kW	1.21	1.56	2.33	3.23	3.81	5.23	6.69
		low	kW	1.02	1.26	1.73	2.48	3.11	3.93	4.45
	Sensible capacity	high	kW	1.17	1.46	2.07	3.09	3.57	4.85	6.26
		medium	kW	0.95	1.27	1.66	2.42	2.87	3.80	4.88
		low	kW	0.78	1.02	1.24	1.78	2.28	2.82	3.22
HEATING CAPACITY (2)		high	kW	2.23	2.07	2.91	4.51	4.67	7.91	9.30
		medium	kW	1.89	1.84	2.53	3.75	4.10	6.83	7.95
		low	kW	1.62	1.61	2.06	3.11	3.56	5.69	6.12

TECHNICAL SPECIFICATIONS										
MODEL			FW..01C**	FW..02C**	FW..03C**	FW..04C**	FW..06C**	FW..08C**	FW..10C**	
DIMENSIONS	FWW/FWL	mm	564x774x226		564x984x226	564x1,194x226	564x1,194x226	564x1,404x251		
	FWM	mm	535x584x224		535x794x224	535x1,004x224	535x1,004x224	535x1,214x249		
WEIGHT	FWW	kg	20	21	26	32	33	44	44	
	FWL	kg	21	22	28	34	35	46	46	
	FWM	kg	15	16	20	26	25	34	34	
MATERIAL	FWW/FWL/FWM	Plastic + sheet metal								
COLOUR		Plastic and metal RAL9010								
SOUND LEVEL	Sound power	high	dB(A)	47	54	50	55	59	59	66
		medium	dB(A)	39	48	45	48	53	52	58
		low	dB(A)	34	42	38	40	46	44	48
WATER FLOW	Cooling	l/h	268	308	494	733	803	1142	1471	
	Heating	l/h	196	182	286	396	465	694	816	
WATER PRESSURE DROP	Cooling	kPa	13	13	11	12	14	12	19	
	Heating	kPa	7	8	5	10	10	8	9	
FAN	Type	Centrifugal multi-blade, double suction								
	Air flow rate at 0 Pa ESP	high	m ³ /h	307	327	431	690	763	998	1362
		medium	m ³ /h	225	261	332	490	593	765	1007
		low	m ³ /h	174	205	238	356	460	565	636
Speed	3 steps: high, medium, low									
Qty			1	1	2	2	2	2	2	
MOTOR	Type	Closed induction, B class insulation, winding thermal cut-out								
HEAT EXCHANGER	Rows x stages x fin pitch	mm	1x8x1.6	1x8x1.6	1x8x1.6	1x8x1.6	1x8x1.6	1x10x1.6	1x10x1.6	
	Face area	m ²	0.068	0.068	0.110	0.152	0.152	0.243	0.243	
	Water volume	ℓ	0.2	0.2	0.3	0.4	0.4	0.6	0.6	
AIR FILTER		Plastic								
INSULATION MATERIAL		Class 1 self-extinguishing								
VIBRATION ISOLATOR		Rubber ring for fan motor								
PIPING CONNECTIONS	Water inlet/outlet	inch	1/2"	1/2"	1/2"	1/2"	1/2"	3/4"	3/4"	
	Drain FWW	mm	16							
	Drain FWM	mm	17							

4TW60011-1

NOTES

- rating conditions cooling 4 pipe: air 27°C DB - 19°C WB - entering water 7°C - leaving water 12°C
- rating conditions heating 4 pipe: air 20°C DB - entering water 70°C - leaving water 60°C

SYMBOLS

- ** : TN = 2-pipe, without valves
 TV = 2-pipe, with ON / OFF valves
 FN = 4-pipe, without valves



3 Specifications

3-1 Technical specifications

3-1-3 FWD - 2-pipe series

3-1

NOMINAL CAPACITY and NOMINAL INPUT											
MODEL			FWD04A*	FWD06A*	FWD08A*	FWD10A*	FWD12A*	FWD16A*	FWD18A*		
POWER CONSUMPTION			W	177	274	315	325	530	991	1001	
Current input			A	0.77	1.34	1.51	1.54	2.60	4.80	4.83	
COOLING CAPACITY (1)	Total capacity	high	kW	3.90	6.20	7.80	8.82	11.90	16.40	18.30	
	Sensible capacity	high	kW	3.08	4.65	6.52	7.16	9.36	12.80	14.10	
HEATING CAPACITY (2)			high	kW	4.05	7.71	9.43	10.79	14.45	19.81	21.92

TECHNICAL SPECIFICATIONS										
MODEL			FWD04A*	FWD06A*	FWD08A*	FWD10A*	FWD12A*	FWD16A*	FWD18A*	
DIMENSIONS			mm	280x754x559	280x964x559	280x1,174x559		352x1,174x718	352x1,384x718	
WEIGHT			kg	33	41	47	49	65	7è	80
MATERIAL			Galvanised sheet metal							
COLOUR			Not painted (galvanised)							
SOUND LEVEL at ESP = 0 Pa	Sound power	high	dB(A)	66	69	72	72	74	78	78
		medium	dB(A)	61	63	67	67	67	73	73
		low	dB(A)	54	59	62	62	60	69	69
WATER FLOW	Cooling		l/h	674	1064	1339	1514	2056	2833	3140
	Heating		l/h	674	1064	1339	1514	2056	2833	3140
WATER PRESSURE DROP	Cooling		kPa	17	24	24	16	26	34	45
	Heating		kPa	14	20	20	13	21	28	37
FAN	Type		Centrifugal multi-blade, double suction							
	Air flow rate	high	m³/h	800	1250	1600	1600	2200	3000	3000
	Available pressure		Pa	66	58	68	64	97	145	134
	Speed		3 steps: high, medium, low							
Qty			1	2	2	2	2	2	2	
MOTOR			Type Closed induction, B class insulation, winding thermal cut-out							
HEAT EXCHANGER	Rows x stages x fin pitch	mm	3x10x2.1	3x10x1.8	3x10x2.1	4x10x2.1	3x14x2.1	4x14x2.1	5x14x2.1	
	Face area	m²	0.138	0.1905	0.243	0.243	0.3402	0.4137	0.4137	
	Water volume	ℓ	1.06	1.42	1.79	2.38	2.5	4.02	5.03	
AIR FILTER			Acrylic - Filtering class EU2							
INSULATION MATERIAL			Class 1 self-extinguishing							
VIBRATION ISOLATOR			Rubber ring for fan motor							
PIPING CONNECTIONS	Water inlet/outlet	inch	3/4"							
	Drain	mm	16							

4TW60221-1

NOTES

- rating conditions cooling 2 pipe: air 27°C DB - 19°C WB - entering water 7°C - leaving water 12°C at nominal air flow and ESP
- rating conditions heating 2 pipe: air 20°C DB - entering water 50°C - water flow as in cooling mode at nominal air flow and ESP

SYMBOLS

- *: T = 2-pipe
- F = 4-pipe



3 Specifications

3-1 Technical specifications

3-1-4 FWD - 4-pipe series

3

3-1

NOMINAL CAPACITY and NOMINAL INPUT										
MODEL			FWD04A*	FWD06A*	FWD08A*	FWD10A*	FWD12A*	FWD16A*	FWD18A*	
POWER CONSUMPTION			W	177	274	315	325	530	991	1001
Current input			A	0.77	1.34	1.51	1.54	2.60	4.80	4.83
COOLING CAPACITY (1)	Total capacity	high	kW	3.90	6.20	7.80	8.82	11.90	16.40	18.30
	Sensible capacity	high	kW	3.08	4.65	6.52	7.16	9.36	12.80	14.10
HEATING CAPACITY (2)			high	kW	4.49	6.62	9.21	9.21	15.86	21.15

TECHNICAL SPECIFICATIONS										
MODEL			FWD04A*	FWD06A*	FWD08A*	FWD10A*	FWD12A*	FWD16A*	FWD18A*	
DIMENSIONS			mm	280x754x559	280x964x559	280x1,174x559		352x1,174x718	352x1,384x718	
WEIGHT			kg	35	43	50	52	71	83	86
MATERIAL			Plastic + sheet metal							
COLOUR			Not painted (galvanised)							
SOUND LEVEL at ESP = 0 Pa	Sound power	high	dB(A)	66	69	72	72	74	78	78
		medium	dB(A)	61	63	67	67	67	73	73
		low	dB(A)	54	59	62	62	60	69	69
WATER FLOW	Cooling		l/h	674	1064	1339	1514	2056	2833	3140
	Heating		l/h	349	581	808	808	1392	1856	1856
WATER PRESSURE DROP	Cooling		kPa	17	24	24	16	26	34	45
	Heating		kPa	9	15	13	13	12	16	16
FAN	Type		Centrifugal multi-blade, double suction							
	Air flow rate	high	m ³ /h	800	1250	1600	1600	2200	3000	3000
	Available pressure		Pa	63	53	63	59	92	138	128
	Speed		3 steps: high, medium, low							
Qty				1	2	2	2	2	2	2
MOTOR			Type							Closed induction, B class insulation, winding thermal cut-out
HEAT EXCHANGER	Rows x stages x fin pitch		mm	1x10x1.8	1x10x1.8	1x10x1.8	1x10x1.8	2x12x2.1	2x12x2.1	2x12x2.1
	Face area		m ²	0.138	0.1905	0.243	0.243	0.3402	0.4137	0.4137
	Water volume		ℓ	0.35	0.47	0.59	0.59	1.42	1.72	1.72
AIR FILTER			Plastic							
INSULATION MATERIAL			Class 1 self-extinguishing							
VIBRATION INSULATION			Rubber ring for fan motor							
PIPING CONNECTIONS	Water inlet/outlet		inch	3/4"				1		
	Drain		mm	16						

4TW60221-1

NOTES

- rating conditions cooling 4 pipe: air 27°C DB - 19°C WB - entering water 7°C - leaving water 12°C at nominal air flow and ESP
- rating conditions heating 4 pipe: air 20°C DB - entering water 70°C - leaving water 60°C at nominal air flow and ESP

SYMBOLS

- *: T = 2-pipe
F = 4-pipe



3 Specifications

3-1 Technical specifications

3 3-1-5 FWB

3-1

NOMINAL CAPACITY and NOMINAL INPUT												
MODEL			FWB02C	FWB03C	FWB04C	FWB05C	FWB06C	FWB07C	FWB08C	FWB09C	FWB10C	
POWER INPUT	high	W	106	106	106	192	192	192	294	294	294	
	medium	W	56	56	56	143	143	143	193	193	193	
	low	W	34	34	34	76	76	76	155	155	155	
COOLING CAPACITY (1)	Total capacity	high	kW	2.61	3.14	3.49	5.08	5.45	6.47	7.57	8.67	10.34
		medium	kW	2.01	2.42	2.64	3.99	4.12	4.96	5.41	6.08	7.08
		low	kW	1.34	1.5	1.67	2.12	2.43	2.67	4.18	4.64	5.35
	Sensible capacity	high	kW	1.88	2.16	2.34	3.6	3.87	4.4	5.23	5.96	6.9
		medium	kW	1.46	1.66	1.77	2.84	2.96	3.37	3.78	4.2	4.72
		low	kW	0.95	1.02	1.1	1.52	1.67	1.78	2.95	3.21	3.57
HEATING CAPACITY (2) (2-pipe)	high	kW	5.47	6.01	6.47	10.31	11.39	12.28	15.05	16.85	18.78	
	medium	kW	4.32	4.66	4.93	8.2	8.92	9.48	10.94	11.97	12.93	
	low	kW	2.77	2.91	3.00	4.56	4.77	4.94	8.63	9.29	9.85	
HEATING CAPACITY (2) (4-pipe)	high	kW	3.14	3.14	3.14	5.99	5.99	5.99	12.8	12.8	12.8	
	medium	kW	2.68	2.68	2.68	5.14	5.14	5.14	9.55	9.55	9.55	
	low	kW	1.95	1.95	1.95	3.38	3.38	3.38	7.67	7.67	7.67	

TECHNICAL SPECIFICATIONS													
MODEL			FWB02C	FWB03C	FWB04C	FWB05C	FWB06C	FWB07C	FWB08C	FWB09C	FWB10C		
DIMENSIONS	unit	H / W / D	mm	239/1,039/551	239/1,039/551	239/1,039/551	239/1,389/551	239/1,389/551	239/1,389/551	239/1,739/551	239/1,739/551		
	Unit with packing	H / W / D	mm	305/1,100/650	305/1,100/650	305/1,100/650	305/1,450/650	305/1,450/650	305/1,450/650	305/1,800/650	305/1,800/650		
WEIGHT	Machine weight	kg	23	24	26	31	33	35	43	45	48		
	Operation weight	kg	24	26	26	33	35	38	45	48	52		
	Gross weight	kg	26	27	29	35	37	39	47	50	54		
MATERIAL	Galvanized sheet metal												
SOUND LEVEL (3)	Sound pressure	H / M / L	dB(A)	46.5/34.5/24.5	46.5/34.5/24.5	46.5/34.5/24.5	48.5/40.5/25.5	48.5/40.5/25.5	48.5/40.5/25.5	57.5/46.5/41.5	57.5/46.5/41.5		
	Sound power	H / M / L	dB(A)	58/46/36	58/46/36	58/46/36	60/52/37	60/52/37	60/52/37	69/58/53	69/58/53		
WATER FLOW	Cooling	l/h	448	539	598	873	936	1,111	1,299	1,488	1,774		
	Heating	l/h	480	527	567	904	999	1,077	1,319	1,479	1,647		
	Add. heat exch.	l/h	275	275	275	526	526	526	1,123	1,123	1,123		
WATER PRESSURE DROP	Cooling	kPa	8	14	11	15	8	14	21	21	26		
	Heating	kPa	7	10	8	12	7	10	16	15	18		
	Add. heat exch.	kPa	3	3	3	5	5	5	8	8	8		
FAN	Type	Centrifugal - forward blades - directly coupled on fan motor											
	Air flow rate	H / M / L	m ³ /h	400/300/180	400/300/180	400/300/180	800/600/300	800/600/300	800/600/300	1,200/800/600	1,200/800/600	1,200/800/600	
	Available pressure	H / M / L	Pa	71/29/20	71/29/20	71/29/20	65/44/23	65/44/23	65/44/23	59/43/29	59/43/29	59/43/29	
	Speed	7 speeds (high = 7, medium = 4, low = 1)											
	Qty	1			2			3					
MOTOR	Type	Closed induction, B class insulation, winding thermal cut-out											
STANDARD HEAT EXCHANGER	Rows x stages x fin pitch	mm	3 x 3 x 2.1	4 x 3 x 2.1	6 x 4 x 2.1	3 x 4 x 2.1	4 x 6 x 2.1	6 x 6 x 2.5	3 x 5 x 2.1	4 x 6 x 2.1	6 x 6 x 2.1		
	Face area	m ²	0.15	0.15	0.15	0.22	0.22	0.22	0.29	0.29	0.29		
	Water volume	ℓ	1.1	1.5	2.2	1.6	2.1	3.2	2.1	2.8	4.2		
ADDITIONAL HEAT EXCHANGER	Rows x stages x fin pitch	mm	1 x 2 x 1.8			1 x 3 x 1.8			2 x 6 x 2.1				
	Face area	m ²	0.14			0.24			0.35				
	Water volume	ℓ	0.4			0.6			1.7				
AIR FILTER	Standard filter class EU2												
INSULATION MATERIAL	Class 1 self-extinguishing												
VIBRATION INSULATION	Rubber ring for fan motor												
WATER CONNECTION	Std. heat exch.	inch					3/4						
	Add. heat exch.	inch					3/4			1			
DRAIN		mm								16			

4TW60291-1

NOTES

- 1 rating conditions cooling 4 pipe: air 27°C DB - 19°C WB - entering water 7°C - leaving water 12°C
- 2 Rating conditions heating 2 pipe: air 20°C DB - entering water 70°C - leaving water 60°C
- 3 Sound power level according to ISO3741 - sound pressure calculated at 1.5 m distance - Q = 2



3 Specifications

3-2 Electrical specifications

3-2-1 FWV-FWL-FWM

ELECTRICAL SPECIFICATIONS										
MODEL			FW.01C**	FW.02C**	FW.02C**	FW.03C**	FW.04C**	FW.06C**	FW.08C**	FW.10C**
POWER CONSUMPTION	high	W	36	46	59	62	87	89	182	244
	medium	W	26	32	41	46	61	62	127	169
	low	W	21	21	27	30	41	42	86	109
Current input	high	A	0.16	0.21		0.27	0.39	0.38	0.80	1.12
	medium	A	0.12	0.15		0.20	0.28	0.28	0.57	0.79
	low	A	0.10	0.10		0.14	0.19	0.19	0.40	0.55
Required power supply	V / f / Hz		230 / 1 / 50							
Required fuses	A		0.5	0.5		0.5	0.5	0.5	1	2
Required wire section	mm		1	1		1	1	1	&	1

4TW60011-2

The power consumption for the valve motor is 5 W (peak) only during opening

3-2-2 FWD

ELECTRICAL SPECIFICATIONS										
MODEL			FWD04A*	FWD06A*	FWD08A*	FWD10A*	FWD12A*	FWD16A*	FWD18A*	
Maximum power input at ESP = 0 Pa	high	W	234	349	443	443	714	1.197	1.197	
	medium	W	173	294	336	336	473	966	966	
	low	W	130	247	261	261	328	704	704	
Current input at ESP = 0 Pa	high	A	0.95	1.58	1.97	1.971	3.210	5.370	5.370	
	medium	A	0.74	1.39	1.52	1.515	2.080	4.380	4.380	
	low	A	0.57	1.18	1.20	1.204	1.500	3.260	3.260	
Required power supply	V / f / Hz		230 / 1 / 50							
Required fuses	A		2	2	2	4	4	6	6	
Required wire section	mm ²		1	1	1.5	1.5	2	2.5	2.5	

4TW60221-2

The power consumption for the valve motor is 5 W (peak) only during opening

3-2-3 FWB

ELECTRICAL SPECIFICATIONS											
MODEL			FWB02C	FWB03C	FWB04C	FWB05C	FWB06C	FWB07C	FWB08C	FWB09C	FWB10C
Current input	high	A	0.51	0.51	0.51	0.94	0.94	0.94	1.28	1.28	1.28
	medium	A	0.30	0.30	0.30	0.70	0.7	0.7	0.9	0.9	0.9
	low	A	0.20	0.20	0.20	0.40	0.4	0.4	0.7	0.7	0.7
Required power supply	V / f / Hz		230 - 1 - 50								
Required fuses	A		1	1	1	2	2	2	2	2	2
Required wire section	mm ²		1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5
Electric heater	Power input	kW	2	2	2	2.5	2.5	2.5	3	3	3
	Current	A	8.7	8.7	8.7	10.9	10.9	10.9	13	13	13
	Power supply	V / f / Hz		230 - 1 - 50							

4TW60291-1

The power consumption for the valve motor is 5 W (peak) only during opening



4 Power consumption in function of ESP and speed

4-1 FWV/FWL/FWM - 2-pipe series

4
4-1

FW..01	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	36	0.161	26	0.112	21	0.091
10	36	0.159	25	0.110	21	0.090
20	35	0.154	25	0.109	20	0.088
30	35	0.150	24	0.105		
45	34	0.144				
50	33	0.137				

4TW60011-2 (2/15)

FW..02	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	46	0.196	32	0.136	21	0.108
10	46	0.193	32	0.134	21	0.107
20	46	0.193	31	0.132	21	0.106
30	44	0.192	31	0.131	20	0.104
40	44	0.191	30	0.129		

4TW60011-2 (3/15)

FW..03	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	62	0.271	46	0.204	30	0.138
10	61	0.262	44	0.197	29	0.134
20	59	0.253	45	0.192	29	0.131
30	58	0.247	43	0.186	28	0.130
40	56	0.240	42	0.181		
50	54	0.233				

4TW60011-2 (4/15)

FW..04	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	87	0.402	61	0.287	41	0.192
10	83	0.386	59	0.276	40	0.187
20	81	0.371	57	0.259	39	0.173
30	79	0.356	55	0.254	37	0.171
40	77	0.343	53	0.242	34	0.160
50	74	0.331	50	0.228		
60	70	0.319	45	0.211		
70	65	0.300				
75	63	0.296				

4TW60011-2 (5/15)

SYMBOLS

ESP: External static pressure



4 Power consumption in function of ESP and speed

4-1 FWV/FWL/FWM - 2-pipe series

4

4-1

FW..06	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	89	0.386	62	0.283	42	0.190
10	87	0.377	62	0.277	40	0.184
20	85	0.366	59	0.266	40	0.179
30	82	0.354	57	0.255	38	0.173
40	81	0.349	56	0.243	37	0.165
50	80	0.343	53	0.233		
60	76	0.331	49	0.217		
70	72	0.315				

4TW60011-2 (6/15)

FW..08	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	182	0.802	127	0.574	86	0.393
10	178	0.780	124	0.560	83	0.385
20	174	0.761	121	0.547	82	0.377
30	169	0.741	118	0.532	81	0.371
40	166	0.721	116	0.522	80	0.363
50	161	0.698	114	0.509	78	0.354
60	157	0.680	111	0.497	76	0.343
70	153	0.662	108	0.482		
80	147	0.639	104	0.464		
90	142	0.620	101	0.453		
100	137	0.595				

4TW60011-2 (7/15)

FW..10	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	244	1.065	169	0.780	109	0.543
10	240	1.048	165	0.753	108	0.528
20	232	1.010	160	0.735	106	0.513
30	222	0.985	155	0.711	105	0.500
40	214	0.960	151	0.690	104	0.495
50	207	0.925	147	0.673	102	0.485
60	199	0.900	143	0.656	96	0.453
70	192	0.872	139	0.636		
80	188	0.847	135	0.615		
90	183	0.820	129	0.591		
100	176	0.799				

4TW60011-2 (8/15)

SYMBOLS

ESP: External static pressure



4 Power consumption in function of ESP and speed

4-2 FWV/FWL/FWM - 4-pipe series

4
4-2

FW..01	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	36	0.161	26	0.112	21	0.091
10	36	0.159	25	0.110	21	0.090
20	35	0.154	25	0.109	20	0.088
30	35	0.150	24	0.105		
45	34	0.144				
50	33	0.137				

4TW60011-2 (9/15)

FW..02	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	59	0.246	41	0.174	27	0.139
10	58	0.243	40	0.173	27	0.138
20	57	0.243	40	0.170	27	0.136
30	57	0.242	40	0.169	30	0.130
40	57	0.241	39	0.168		

4TW60011-2 (10/15)

FW..03	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	62	0.271	46	0.204	30	0.138
10	61	0.262	44	0.197	29	0.134
20	59	0.253	45	0.192	29	0.131
30	58	0.247	43	0.186	28	0.130
40	56	0.240	42	0.181		
50	54	0.233				

4TW60011-2 (11/15)

FW..04	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	87	0.402	61	0.287	41	0.192
10	83	0.386	59	0.276	40	0.187
20	81	0.371	57	0.259	39	0.173
30	79	0.356	55	0.254	37	0.171
40	77	0.343	53	0.242	34	0.160
50	74	0.331	50	0.228		
60	70	0.319	45	0.211		
70	65	0.300				
75	63	0.296				

4TW60011-2 (12/15)

SYMBOLS

ESP: External static pressure



4 Power consumption in function of ESP and speed

4-2 FWV/FWL/FWM - 4-pipe series

4

4-2

FW..06	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	89	0.386	62	0.283	42	0.190
10	87	0.377	62	0.277	40	0.184
20	85	0.366	59	0.266	40	0.179
30	82	0.354	57	0.255	38	0.173
40	81	0.349	56	0.243	37	0.165
50	80	0.343	53	0.233		
60	76	0.331	49	0.217		
70	72	0.315				

4TW60011-2 (13/15)

FW..08	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	182	0.802	127	0.574	86	0.393
10	178	0.780	124	0.560	83	0.385
20	174	0.761	121	0.547	82	0.377
30	169	0.741	118	0.532	81	0.371
40	166	0.721	116	0.522	80	0.363
50	161	0.698	114	0.509	78	0.354
60	157	0.680	111	0.497	76	0.343
70	153	0.662	108	0.482		
80	147	0.639	104	0.464		
90	142	0.620	101	0.453		
100	137	0.595				

4TW60011-2 (14/15)

FW..10	Max.		Med.		Min.	
	ESP	Power input	Current	Power input	Current	Power input
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	244	1.065	169	0.780	109	0.543
10	240	1.048	165	0.753	108	0.528
20	232	1.010	160	0.735	106	0.513
30	222	0.985	155	0.711	105	0.500
40	214	0.960	151	0.690	104	0.495
50	207	0.925	147	0.673	102	0.485
60	199	0.900	143	0.656	96	0.453
70	192	0.872	139	0.636		
80	188	0.847	135	0.615		
90	183	0.820	129	0.591		
100	176	0.799				

4TW60011-2 (15/15)

SYMBOLS

ESP: External static pressure



4 Power consumption in function of ESP and speed

4-3 FWD -2-pipe series/4-pipe

4
4-3

FWD04	Max.		Med.		Min.		
	ESP	Power input	Current	Power input	Current	Power input	Current
	(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0		234	0.954	173	0.740	130	0.568
10		228	0.946	169	0.740	122	0.550
20		221	0.940	165	0.731	120	0.530
30		211	0.912	161	0.720	117	0.525
40		203	0.890	157	0.702	114	0.514
50		196	0.857	148	0.655	112	0.496
60		182	0.792	144	0.633	109	0.485
70		173	0.754	140	0.616	107	0.473
80		166	0.710	132	0.573	104	0.456
90		158	0.671	125	0.545	100	0.444
100		153	0.639	120	0.520	95	0.419
120		141	0.594	112	0.477	85	0.375
140		130	0.542	97	0.428	77	0.327
160		115	0.471				

4TW60221-2 (2/8)

FWD06	Max.		Med.		Min.		
	ESP	Power input	Current	Power input	Current	Power input	Current
	(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0		349	1.575	294	1.389	247	1.183
10		329	1.530	275	1.322	238	1.150
20		317	1.490	263	1.287	230	1.120
30		303	1.470	256	1.246	225	1.092
40		295	1.430	246	1.194	218	1.065
50		286	1.380	237	1.159	210	1.036
60		274	1.340	228	1.115	204	1.001
70		264	1.306	218	1.078	199	0.974
80		256	1.265	212	1.038	187	0.933
90		246	1.220	200	0.986	180	0.885
100		235	1.170	191	0.951	170	0.849
110		224	1.130	183	0.910	159	0.791
120		212	1.090	167	0.841	145	0.730
130		192	1.010	154.0	0.790	136	0.691
140		178	0.967	140.0	0.725	120	0.623
150		161	0.905	126.0	0.688	114	0.598
160		152	0.880				

4TW60221-2 (3/8)

SYMBOLS

ESP: External static pressure



4 Power consumption in function of ESP and speed

4-3 FWD -2-pipe series/4-pipe

4

4-3

FWD08	Max.		Med.		Min.	
	Power input	Current	Power input	Current	Power input	Current
ESP (Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	443	1.971	336	1.515	261	1.204
10	420	1.915	317	1.475	247	1.186
20	404	1.850	301	1.418	238	1.144
30	382	1.808	290	1.366	231	1.106
40	367	1.715	279	1.330	221	1.045
52	353	1.670	262	1.246	212	1.008
60	335	1.582	251	1.189	203	0.972
70	315	1.508	248	1.163	195	0.935
80	302	1.430	233	1.109	186	0.885
90	280	1.350	221	1.045	176	0.839
100	267	1.292	210	0.994	168	0.804
110	254	1.224	198	0.936	155	0.741
120	238	1.166	185	0.889	146	0.705
130	225	1.106	172	0.826	135	0.648
140	203	1.028	155	0.746	126	0.605
150	193	0.970	142	0.682	118	0.576
160	174	0.897				

4TW60221-2 (4/8)

FWD10	Max.		Med.		Min.	
	Power input	Current	Power input	Current	Power input	Current
ESP (Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	443	1.971	336	1.515	261	1.204
10	420	1.915	317	1.475	247	1.186
20	404	1.850	301	1.418	238	1.144
30	382	1.808	290	1.366	231	1.106
40	367	1.715	279	1.330	221	1.045
52	353	1.670	262	1.246	212	1.008
60	335	1.582	251	1.189	203	0.972
70	315	1.508	248	1.163	195	0.935
80	302	1.430	233	1.109	186	0.885
90	280	1.350	221	1.045	176	0.839
100	267	1.292	210	0.994	168	0.804
110	254	1.224	198	0.936	155	0.741
120	238	1.166	185	0.889	146	0.705
130	225	1.106	172	0.826	135	0.648
140	203	1.028	155	0.746	126	0.605
150	193	0.970	142	0.682	118	0.576
160	174	0.897				

4TW60221-2 (5/8)

SYMBOLS

ESP: External static pressure



4 Power consumption in function of ESP and speed

4-3 FWD -2-pipe series/4-pipe

4
4-3

FWD12 ESP (Pa)	Max.		Med.		Min.	
	Power input (W)	Current (A)	Power input (W)	Current (A)	Power input (W)	Current (A)
0	714	3.210	473	2.080	328	1.500
10	683	3.100	452	2.070	309	1.485
20	663	3.070	440	2.060	303	1.460
30	646	3.020	430	2.040	299	1.438
40	630	2.990	420	1.970	290	1.403
50	620	2.950	415	1.915	287	1.382
60	604	2.895	402	1.900	278	1.338
70	580	2.800	390	1.860	272	1.306
80	570	2.730	380	1.790	267	1.280
90	550	2.650	370	1.730	257	1.236
100	530	2.600	350	1.650	252	1.213
110	520	2.540	340	1.600	249	1.190
120	490	2.450	330	1.540	244	1.173
130	480	2.390	320	1.480	239	1.139
140	450	2.300	310	1.440	235	1.118
150	440	2.225	300	1.380	230	1.100
160	430	2.210				

4TW60221-2 (6/8)

FWD16 ESP (Pa)	Max.		Med.		Min.	
	Power input (W)	Current (A)	Power input (W)	Current (A)	Power input (W)	Current (A)
0	1197	5.370	966	4.380	704	3.260
10	1159	5.300	921	4.200	680	3.250
20	1130	5.250	897	4.090	672	3.240
30	1112	5.200	879	4.046	660	3.200
40	1092	5.100	864	3.986	650	3.150
50	1086	5.090	848	3.930	640	3.080
60	1068	5.060	842	3.910	638	3.010
70	1060	5.020	830	3.883	629	2.990
80	1051	5.000	820	3.823	624	2.963
90	1050	4.960	810	3.774	620	2.958
100	1034	4.930	800	3.693	610	2.930
110	1026	4.900	790	3.620	600	2.870
120	1017	4.880	760	3.540	590	2.830
130	1006	4.850	743	3.480	580	2.790
140	997	4.820	730	3.420	570	2.740
150	985	4.790	717	3.400	556	2.690
160	973	4.760	710	3.350	540	2.600
170	963	4.690	703	3.300	532	2.566
180	944	4.620	680	3.200	520	2.470
190	926	4.550	661	3.133		
200	912	4.493	655	3.120		
210	894	4.405				
220	877	4.313				
230	860	4.215				
240	848	4.150				
250	841	4.117				

4TW60221-2 (7/8)



4 Power consumption in function of ESP and speed

4-3 FWD -2-pipe series/4-pipe

4

4-3

FWD18 ESP	Max.		Med.		Min.	
	Power input	Current	Power input	Current	Power input	Current
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)
0	1197	5.370	966	4.380	704	3.260
10	1159	5.300	921	4.200	680	3.250
20	1130	5.250	897	4.090	672	3.240
30	1112	5.200	879	4.046	660	3.200
40	1092	5.100	864	3.986	650	3.150
50	1086	5.090	848	3.930	640	3.080
60	1068	5.060	842	3.910	638	3.010
70	1060	5.020	830	3.883	629	2.990
80	1051	5.000	820	3.823	624	2.963
90	1050	4.960	810	3.774	620	2.958
100	1034	4.930	800	3.693	610	2.930
110	1026	4.900	790	3.620	600	2.870
120	1017	4.880	760	3.540	590	2.830
130	1006	4.850	743	3.480	580	2.790
140	997	4.820	730	3.420	570	2.740
150	985	4.790	717	3.400	556	2.690
160	973	4.760	710	3.350	540	2.600
170	963	4.690	703	3.300	532	2.566
180	944	4.620	680	3.200	520	2.470
190	926	4.550	661	3.133		
200	912	4.493	655	3.120		
210	894	4.405				
220	877	4.313				
230	860	4.215				
240	848	4.150				
250	841	4.117				

4TW60221-2 (8/8)

SYMBOLS

ESP: External static pressure



4 Power consumption in function of ESP and speed

4-4 FWB

4 FWB02-04

4-4

Speed	7 (Max.)		6		5		4		3		2		1 (Min.)	
AP	Power input	Current	Power input	Current	Power input	Current	Power input	Current	Power input	Current	Power input	Current	Power input	Current
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)	(W)	(A)	(W)	(A)	(W)	(A)	(W)	(A)
0	106	0.506	85	0.413	69	0.342	56	0.285	47	0.241	40	0.208	34	0.180
20	100	0.483	81	0.394	66	0.326	54	0.273	45	0.232	38	0.200	32	0.173
40	96	0.463	76	0.374	63	0.309	51	0.260	43	0.222	36	0.192		
60	90	0.438	71	0.355	60	0.296	49	0.250						
80	84	0.415	68	0.340	56	0.282								
100	80	0.399	65	0.326										

4TW60291-2 (2/4)

FWB05-07

Speed	7 (Max.)		6		5		4		3		2		1 (Min.)	
AP	Power input	Current	Power input	Current	Power input	Current	Power input	Current	Power input	Current	Power input	Current	Power input	Current
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)	(W)	(A)	(W)	(A)	(W)	(A)	(W)	(A)
0	192	0.944	167	0.842	156	0.789	143	0.736	115	0.592	92	0.487	76	0.408
20	182	0.893	160	0.809	150	0.752	136	0.695	108	0.560	88	0.463	73	0.390
40	170	0.837	150	0.752	141	0.708	130	0.660	103	0.531	85	0.443	70	0.372
60	156	0.778	141	0.708	132	0.664	122	0.618	98	0.504	80	0.420	68	0.360
80	148	0.728	131	0.658	124	0.621	115	0.581	92	0.475	77	0.399		
100	138	0.684	122	0.613	115	0.580	107	0.545	88	0.447				

4TW60291-2 (3/4)

FWB08-10

Speed	7 (Max.)		6		5		4		3		2		1 (Min.)	
AP	Power input	Current	Power input	Current	Power input	Current	Power input	Current	Power input	Current	Power input	Current	Power input	Current
(Pa)	(W)	(A)	(W)	(A)	(W)	(A)	(W)	(A)	(W)	(A)	(W)	(A)	(W)	(A)
0	294	1.274	252	1.104	224	0.995	193	0.878	177	0.817	164	0.761	155	0.727
20	278	1.210	240	1.045	211	0.930	181	0.810	168	0.768	155	0.718	149	0.688
40	265	1.157	223	0.985	198	0.872	170	0.763	160	0.723	148	0.680	142	0.650
60	251	1.100	211	0.927	184	0.815	158	0.709	148	0.670	138	0.627	135	0.606
80	236	1.035	200	0.876	172	0.753	145	0.650	138	0.615				
100	224	0.980	186	0.815										

4TW60291-2 (4/4)

5 Capacity tables

5-1 Cooling capacities FWV/FWL/FWM - 2-pipe



Air temperature (°C DB - °C WB)		22 - 16															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
		W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FW.01 TN/TV	Max.	880	840	152	5	820	820	140	4	730	730	125	4	650	650	111	3
	Med.	720	720	124	4	660	660	114	3	610	610	104	3	550	550	95	2
	Min.	640	570	110	3	580	580	100	2	540	540	92	2	490	490	84	2
FW.02 TN/TV	Max.	1290	1070	221	6	1090	1090	187	4	980	980	169	4	880	880	151	3
	Med.	1120	930	192	5	880	830	151	3	860	860	148	3	790	790	135	2
	Min.	910	750	157	3	780	700	133	2	730	730	125	2	670	670	114	2
FW.03 TN/TV	Max.	1730	1470	296	5	1480	1480	255	3	1370	1370	235	3	1260	1260	216	3
	Med.	1450	1200	249	3	1260	1120	216	3	1180	1180	203	2	1080	1080	186	2
	Min.	1240	960	213	3	1090	890	186	2	920	820	158	1	860	860	149	1
FW.04 TN/TV	Max.	2480	2170	425	5	2140	2140	368	4	1970	1970	339	3	1810	1810	310	3
	Med.	1990	1740	341	3	1720	1630	295	2	1620	1620	279	2	1490	1490	256	2
	Min.	1750	1360	300	3	1520	1270	261	2	1290	1170	221	1	1230	1230	212	1
FW.06 TN/TV	Max.	2820	2570	484	6	2390	2390	410	4	2120	2120	363	3	1930	1930	331	3
	Med.	2150	1990	369	4	1980	1980	340	3	1830	1830	314	3	1670	1670	287	2
	Min.	1960	1650	336	3	1700	1550	292	2	1590	1590	272	2	1460	1460	250	2
FW.08 TN/TV	Max.	3850	3380	661	5	3290	3290	565	4	3040	3040	522	3	2780	2780	478	3
	Med.	3140	2680	539	3	2720	2510	467	3	2570	2570	441	2	2360	2360	405	2
	Min.	2730	2130	469	3	2380	1990	409	2	2010	1840	346	1	1940	1940	333	1
FW.10 TN/TV	Max.	5350	4540	918	8	4380	4380	752	6	3920	3920	672	5	3420	3420	587	4
	Med.	3910	3410	671	5	3310	3310	569	4	3060	3060	525	3	2800	2800	482	3
	Min.	2910	2370	499	3	2530	2210	434	2	2300	2300	394	2	2110	2110	362	2

4TW60012-1 (Sheet 1/13)

5 Capacity tables

5-1 Cooling capacities FWV/FWL/FWM - 2-pipe



24

5-1

5

Air temperature (°C DB - °C WB)		25 - 18															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
		W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FW.01 TN/TV	Max.	1480	1110	254	13	1260	1030	217	9	1020	940	175	6	920	920	158	5
	Med.	1190	900	205	9	1010	830	174	6	810	750	139	4	740	740	126	4
	Min.	1000	740	172	6	850	670	145	5	680	610	117	3	620	620	107	3
FW.02 TN/TV	Max.	2020	1410	346	13	1750	1300	300	10	1450	1190	250	7	1120	1060	193	4
	Med.	1750	1230	300	10	1520	1130	260	8	1260	1030	217	6	970	920	167	3
	Min.	1400	980	240	7	1210	910	208	5	1000	820	172	4	820	750	141	3
FW.03 TN/TV	Max.	2820	1970	484	11	2440	1820	419	8	2010	1640	345	6	1660	1660	284	4
	Med.	2290	1590	393	7	1970	1460	338	6	1590	1310	273	4	1320	1200	226	3
	Min.	1690	1180	290	4	1460	1080	251	3	1300	1020	224	3	1140	950	196	2
FW.04 TN/TV	Max.	4170	2940	715	12	3590	2710	617	9	2940	2450	504	6	2440	2440	418	4
	Med.	3140	2280	538	7	2670	2090	458	5	2080	1860	357	3	1880	1880	322	3
	Min.	2390	1670	410	4	2060	1540	354	3	1830	1440	315	3	1600	1350	274	2
FW.06 TN/TV	Max.	4600	3400	788	14	3970	3150	682	10	3280	2880	562	7	2690	2690	463	5
	Med.	3720	2720	639	9	3200	2510	549	7	2580	2270	443	5	2160	2160	371	4
	Min.	3040	2160	522	7	2580	1970	444	5	2050	1760	352	3	1780	1660	306	3
FW.08 TN/TV	Max.	6470	4590	1109	11	5590	4230	960	9	4590	3830	788	6	3730	3730	640	4
	Med.	5060	3580	868	7	4320	3270	741	6	3360	2890	578	4	2850	2690	489	3
	Min.	3780	2640	649	4	3230	2410	554	3	2870	2270	492	3	2500	2120	429	2
FW.10 TN/TV	Max.	8410	5960	1441	18	7320	5520	1255	14	6110	5050	1049	10	4900	4900	842	7
	Med.	6530	4620	1121	12	5650	4250	970	9	4640	3850	797	6	3770	3770	647	4
	Min.	4300	3030	737	6	3600	2740	618	4	3050	2520	523	3	2650	2360	455	2

4TW60012-1 (Sheet 3/13)

DAIKIN

DAIKIN

5 Capacity tables

5-1 Cooling capacities FWV/FWL/FWM - 2-pipe



Air temperature (°C DB - °C WB)		27 - 19															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
		W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FW.01 TN/TV	Max.	1750	1280	301	17	1540	1200	264	13	1310	1120	226	10	1090	1090	188	7
	Med.	1410	1040	242	12	1240	970	213	9	1060	900	181	7	880	880	151	5
	Min.	1180	850	203	9	1040	790	179	7	890	730	152	5	710	670	122	3
FW.02 TN/TV	Max.	2350	1610	403	16	2090	1510	359	13	1810	1400	311	10	1510	1290	260	8
	Med.	2030	1400	348	13	1810	1310	311	10	1570	1220	270	8	1320	1120	226	6
	Min.	1630	1120	279	9	1450	1050	249	7	1260	970	216	5	1050	890	180	4
FW.03 TN/TV	Max.	3290	2260	564	14	2930	2110	503	11	2540	1950	436	9	2110	1790	362	6
	Med.	2670	1820	459	10	2380	1700	408	8	2060	1570	353	6	1680	1420	289	4
	Min.	1990	1360	341	6	1760	1260	302	5	1500	1150	258	4	1320	1080	227	3
FW.04 TN/TV	Max.	4870	3370	835	15	4330	3150	743	12	3750	2920	643	10	3090	2670	530	7
	Med.	3690	2620	632	9	3270	2450	561	8	2800	2260	481	6	2230	2050	383	4
	Min.	2850	1950	489	6	2510	1800	431	5	2100	1640	361	3	1860	1540	319	3
FW.06 TN/TV	Max.	5360	3890	919	18	4770	3650	818	14	4140	3400	710	11	3430	3140	589	8
	Med.	4350	3120	747	12	3870	2920	664	10	3340	2710	574	8	2730	2480	469	5
	Min.	3570	2490	613	9	3170	2320	544	7	2710	2140	466	5	2150	1920	370	4
FW.08 TN/TV	Max.	7520	5250	1289	15	6710	4910	1152	12	5830	4560	1001	9	4830	4170	829	7
	Med.	5930	4110	1016	10	5270	3830	904	8	4530	3530	778	6	3630	3190	624	4
	Min.	4510	3070	774	6	3970	2840	681	5	3310	2570	569	4	2910	2420	500	3
FW.10 TN/TV	Max.	9740	6800	1671	23	8710	6380	1494	19	7600	5940	1305	15	6380	5480	1096	11
	Med.	7590	5280	1302	15	6780	4940	1163	12	5890	4580	1011	10	4880	4200	838	7
	Min.	5070	3500	870	7	4490	3250	771	6	3820	2980	655	4	3090	2700	530	3

4TW60012-1 (Sheet 5/13)

5 Capacity tables

5-1 Cooling capacities FWV/FWL/FWM - 2-pipe



26

5-1

5

Air temperature (°C DB - °C WB)		30 - 22															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
		W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FW.01 TN/TV	Max.	2640	1520	453	35	2440	1450	419	30	2240	1370	384	26	2020	1290	347	21
	Med.	2120	1230	364	24	1960	1170	337	21	1800	1110	309	18	1630	1050	279	15
	Min.	1770	1020	304	17	1640	960	282	15	1510	910	259	13	1360	860	234	11
FW.02 TN/TV	Max.	3430	1920	589	32	3190	1820	548	28	2940	1730	505	24	2680	1630	460	20
	Med.	2940	1660	505	25	2740	1580	471	22	2530	1500	435	19	2310	1410	397	16
	Min.	2360	1340	404	17	2200	1270	377	15	2030	1200	349	13	1860	1130	319	11
FW.03 TN/TV	Max.	4770	2690	818	27	4450	2550	764	24	4110	2410	706	20	3760	2280	645	17
	Med.	3880	2180	665	19	3620	2070	621	16	3350	1960	575	14	3060	1840	526	12
	Min.	2890	1630	495	11	2700	1550	463	10	2500	1460	429	9	2290	1370	393	7
FW.04 TN/TV	Max.	7110	4000	1220	30	6630	3800	1137	26	6120	3600	1050	22	5580	3400	958	19
	Med.	5400	3120	926	18	5030	2960	864	16	4650	2810	798	14	4240	2650	729	12
	Min.	4190	2350	719	12	3910	2230	671	10	3620	2110	621	9	3300	1980	567	8
FW.06 TN/TV	Max.	7810	4570	1340	34	7280	4350	1249	30	6720	4130	1153	26	6130	3910	1053	22
	Med.	6350	3690	1090	24	5920	3510	1016	21	5470	3330	939	18	4990	3140	857	15
	Min.	5220	2970	895	17	4870	2820	836	15	4500	2670	773	13	4110	2520	706	11
FW.08 TN/TV	Max.	10880	6210	1867	29	10160	5900	1743	25	9400	5600	1613	22	8600	5280	1476	19
	Med.	8610	4890	1478	19	8040	4650	1381	17	7440	4400	1278	15	6810	4150	1169	12
	Min.	6630	3710	1137	12	6190	3520	1062	11	5730	3320	983	9	5230	3120	898	8
FW.10 TN/TV	Max.	14010	7980	2403	44	13090	7610	2247	39	12140	7230	2084	34	11110	6840	1909	29
	Med.	10990	6250	1885	29	10260	5940	1761	26	9490	5630	1629	22	8680	5320	1491	19
	Min.	7400	4190	1269	14	6910	3980	1186	13	6400	3760	1098	11	5850	3540	1004	9

4TW60012-1 (Sheet 7/13)

DAIKIN

DAIKIN

5 Capacity tables

Heating capacities FWV/FWL/FWM - 2-pipe



Air temperature (°C)		20											
Water temperature (Entering °C - leaving °C)		45 - 40			60 - 50			70 - 60			90 - 70		
Model		Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
		W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa
FW.01 TN/TV	Max.	1820	317	15	2840	249	10	3710	325	15	4940	218	7
	Med.	1480	256	11	2310	201	7	2990	263	10	4010	177	5
	Min.	1210	211	8	1900	166	5	2470	216	7	3320	147	3
FW.02 TN/TV	Max.	2350	409	14	3690	322	9	4760	418	13	6410	283	6
	Med.	1950	340	10	3070	268	6	3950	346	10	5340	236	5
	Min.	1600	279	7	2530	221	5	3250	285	7	4420	195	3
FW.03 TN/TV	Max.	3200	556	11	5030	439	7	6460	567	11	8760	386	5
	Med.	2580	449	8	4070	356	5	5220	458	7	7110	314	4
	Min.	1910	332	5	3020	264	3	3860	339	4	5290	233	2
FW.04 TN/TV	Max.	4730	823	12	7420	648	8	9570	840	12	12890	569	6
	Med.	3610	628	8	5690	497	5	7300	641	7	9910	437	4
	Min.	2760	480	5	4360	381	3	5590	490	5	7620	336	2
FW.06 TN/TV	Max.	5360	932	15	8410	735	9	10850	952	14	14620	645	7
	Med.	4390	763	11	6900	603	7	8860	778	10	12020	530	5
	Min.	3570	620	7	5630	491	5	7200	632	7	9810	433	3
FW.08 TN/TV	Max.	7150	1244	12	11240	982	7	14450	1268	11	19550	863	5
	Med.	5690	989	8	8960	783	5	11480	1008	7	15610	689	4
	Min.	4370	759	5	6890	602	3	8830	774	5	12040	531	2
FW.10 TN/TV	Max.	9310	1618	18	14590	1275	11	18830	1652	17	25350	1119	8
	Med.	7240	1258	12	11370	994	7	14630	1283	11	19780	873	5
	Min.	4860	845	6	7670	670	4	9820	862	6	13390	591	3

4TW60012-1 (Sheet 9/13)

5 Capacity tables

5-1 Heating capacities FWV/FWL/FWM - 2-pipe



28

5-1

5

Air temperature (°C)		22											
Water temperature (Entering °C - leaving °C)		45 - 40			60 - 50			70 - 60			90 - 70		
Model		Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
		W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa
FW.01 TN/TV	Max.	1650	287	13	2670	233	8	3530	310	13	4750	210	7
	Med.	1330	232	9	2160	189	6	2850	250	9	3860	170	5
	Min.	1100	191	6	1780	156	4	2350	206	7	3190	141	3
FW.02 TN/TV	Max.	2130	371	12	3460	303	8	4530	398	12	6180	273	6
	Med.	1770	308	9	2880	252	6	3760	330	9	5150	227	4
	Min.	1460	253	6	2370	208	4	3090	271	6	4260	188	3
FW.03 TN/TV	Max.	2900	505	9	4730	413	6	6150	540	10	8430	372	5
	Med.	2340	407	7	3820	334	4	4970	436	7	6840	302	3
	Min.	1730	302	4	2840	248	3	3670	322	4	5090	225	2
FW.04 TN/TV	Max.	4290	746	10	6970	609	7	9110	799	11	12410	548	5
	Med.	3280	570	6	5340	466	4	6960	610	7	9540	421	3
	Min.	2500	436	4	4090	357	3	5320	467	4	7330	324	2
FW.06 TN/TV	Max.	4860	846	13	7900	690	8	10330	906	13	14080	622	6
	Med.	3980	693	9	6490	567	6	8440	740	9	11570	511	5
	Min.	3240	562	6	5280	461	4	6850	601	6	9450	417	3
FW.08 TN/TV	Max.	6490	1129	10	10560	923	7	13760	1207	10	18830	831	5
	Med.	5160	897	7	8410	735	4	10930	960	7	15030	664	3
	Min.	3960	689	4	6470	565	3	8410	737	4	11590	512	2
FW.10 TN/TV	Max.	8440	1468	15	13700	1197	10	17920	1572	16	24410	1077	8
	Med.	6570	1142	10	10690	934	7	13920	1221	10	19050	841	5
	Min.	4410	767	5	7200	629	3	9350	821	5	12900	569	3

4TW60012-1 (Sheet 10/13)

DAIKIN

DAIKIN

5 Capacity tables

5-2 Cooling capacities FWV/FWL/FWM - 4-pipe



Air temperature (°C DB - °C WB)		22 - 16															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
		W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FW.01 FN/FV	Max.	860	810	148	5	790	790	136	4	710	710	122	3	640	640	109	3
	Med.	700	660	120	3	650	650	112	3	600	600	103	3	550	550	94	2
	Min.	640	560	109	3	570	570	98	2	530	530	91	2	480	480	83	2
FW.02 FN/FV	Max.	1030	1030	177	4	940	940	161	3	860	860	147	3	780	780	134	2
	Med.	940	870	162	3	830	830	143	3	770	770	132	2	700	700	121	2
	Min.	830	720	142	3	710	670	122	2	650	650	112	2	600	600	103	1
FW.03 FN/FV	Max.	1680	1430	289	4	1460	1460	251	3	1350	1350	232	3	1240	1240	213	2
	Med.	1440	1180	246	3	1250	1100	214	3	1160	1160	199	2	1070	1070	183	2
	Min.	1230	950	211	3	1080	880	185	2	910	810	157	1	850	850	147	1
FW.04 FN/FV	Max.	2420	2120	415	4	2110	2110	363	4	1950	1950	335	3	1790	1790	307	3
	Med.	1980	1720	339	3	1710	1610	294	2	1610	1610	276	2	1480	1480	254	2
	Min.	1740	1350	298	3	1510	1260	260	2	1280	1160	220	1	1220	1220	210	1
FW.06 FN/FV	Max.	2750	2500	471	5	2330	2330	400	4	2070	2070	356	3	1900	1900	326	3
	Med.	2140	1960	367	4	1960	1960	336	3	1810	1810	310	3	1660	1660	284	2
	Min.	1940	1630	334	3	1690	1520	289	2	1570	1570	269	2	1440	1440	247	2
FW.08 FN/FV	Max.	3790	3330	650	5	3270	3270	561	3	3020	3020	518	3	2760	2760	475	3
	Med.	3130	2660	537	3	2710	2490	465	2	2560	2560	439	2	2350	2350	403	2
	Min.	2720	2120	467	3	2370	1970	407	2	2010	1820	344	1	1930	1930	331	1
FW.10 TN/TV	Min.	5240	4450	899	8	4290	4290	737	6	3830	3830	658	5	3340	3340	574	4
	Med.	3840	3350	658	5	3280	3280	564	3	3030	3030	521	3	2780	2780	477	3
	Min.	2890	2350	496	3	2520	2190	432	2	2280	2280	392	2	2100	2100	360	2

4TW60012-1 (Sheet 2/13)

5 Capacity tables

5-2 Cooling capacities FWV/FWL/FWM - 4-pipe



30

5-2

5

Air temperature (°C DB - °C WB)		25 - 18															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
		W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FW.01 FN/FV	Max.	1450	1080	248	12	1230	1000	211	9	990	910	171	6	890	890	154	5
	Med.	1170	880	200	8	990	810	170	6	790	740	136	4	720	720	123	3
	Min.	980	720	169	6	830	660	143	5	670	600	115	3	620	620	106	3
FW.02 FN/FV	Max.	1730	1360	297	10	1490	1260	256	7	1230	1160	211	5	1050	1050	180	4
	Med.	1500	1140	257	8	1290	1050	222	6	1060	970	183	4	900	900	155	3
	Min.	1210	910	208	5	1040	840	179	4	870	770	150	3	760	760	130	2
FW.03 FN/FV	Max.	2770	1930	474	10	2390	1780	410	8	1970	1610	337	6	1620	1620	278	4
	Med.	2240	1560	384	7	1930	1420	330	5	1550	1270	266	4	1300	1180	224	3
	Min.	1660	1160	285	4	1450	1070	249	3	1290	1000	222	3	1130	940	194	2
FW.04 FN/FV	Max.	4100	2890	703	11	3530	2660	606	9	2880	2410	494	6	2390	2390	411	4
	Med.	3100	2250	532	7	2630	2060	452	5	2070	1840	355	3	1860	1860	320	3
	Min.	2360	1650	405	4	2050	1520	351	3	1820	1430	313	3	1590	1340	273	2
FW.06 FN/FV	Max.	4500	3320	772	13	3890	3080	668	10	3200	2810	550	7	2640	2640	453	5
	Med.	3660	2670	628	9	3150	2460	540	7	2530	2220	435	5	2120	2120	365	3
	Min.	2990	2120	513	6	2530	1940	435	5	2040	1740	350	3	1770	1640	303	2
FW.08 FN/FV	Max.	6390	4540	1097	11	5530	4180	949	9	4530	3780	778	6	3680	3680	633	4
	Med.	5020	3550	862	7	4290	3240	735	6	3330	2860	571	4	2840	2680	487	3
	Min.	3740	2620	642	4	3210	2390	551	3	2860	2250	490	3	2490	2110	427	2
FW.10 TN/TV	Max.	8250	5850	1416	18	7180	5420	1232	14	5990	4950	1029	10	4810	4810	826	7
	Med.	6450	4560	1106	11	5580	4200	957	9	4580	3800	786	6	3720	3720	638	4
	Min.	4260	3000	730	6	3560	2710	612	4	3030	2500	521	3	2640	2350	453	2

4TW60012-1 (Sheet 4/13)

DAIKIN

DAIKIN

5 Capacity tables

5-2 Cooling capacities FWV/FWL/FWM - 4-pipe



Air temperature (°C DB - °C WB)		27 - 19															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
		W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FW.01 FN/FV	Max.	1710	1250	293	16	1500	1170	258	13	1280	1090	220	10	1070	1070	183	7
	Med.	1380	1010	236	11	1210	950	208	9	1030	880	177	7	860	860	147	5
	Min.	1160	830	199	8	1020	780	175	7	870	720	149	5	700	650	120	3
FW.02 FN/FV	Max.	2020	1550	347	13	1790	1460	308	10	1550	1370	266	8	1240	1240	212	5
	Med.	1750	1300	301	10	1560	1270	267	8	1340	1140	231	6	1110	1050	191	4
	Min.	1420	1040	244	7	1260	1020	216	6	1080	910	186	4	890	830	153	3
FW.03 FN/FV	Max.	3220	2210	552	13	2870	2070	493	11	2490	1910	427	8	2060	1750	354	6
	Med.	2610	1780	449	9	2330	1660	400	8	2010	1530	345	6	1640	1390	282	4
	Min.	1960	1340	336	6	1730	1240	297	5	1470	1130	253	3	1310	1070	225	3
FW.04 FN/FV	Max.	4780	3310	821	15	4260	3090	730	12	3680	2870	632	9	3030	2620	520	7
	Med.	3640	2590	625	9	3230	2420	554	7	2760	2230	474	6	2200	2010	377	4
	Min.	2820	1920	483	6	2480	1780	425	5	2080	1620	357	3	1850	1530	317	3
FW.06 FN/FV	Max.	5250	3800	900	17	4670	3570	802	14	4050	3320	696	11	3360	3060	577	8
	Med.	4280	3060	735	12	3810	2870	653	10	3290	2660	564	7	2680	2430	461	5
	Min.	3510	2440	603	8	3110	2280	534	7	2660	2100	457	5	2100	1880	361	3
FW.08 FN/FV	Max.	7430	5190	1275	15	6640	4850	1138	12	5760	4500	990	9	4770	4120	819	7
	Med.	5880	4080	1010	10	5230	3800	898	8	4500	3510	772	6	3600	3160	618	4
	Min.	4470	3050	767	6	3930	2820	675	5	3270	2550	562	3	2900	2400	497	3
FW.10 TN/TV	Max.	9560	6680	1641	23	8550	6260	1468	19	7460	5830	1281	15	6260	5370	1074	11
	Med.	7500	5210	1286	15	6690	4880	1148	12	5810	4520	998	9	4810	4140	827	7
	Min.	5030	3470	862	7	4450	3220	763	6	3780	2950	649	4	3070	2680	528	3

4TW60012-1 (Sheet 6/13)

5 Capacity tables

5-2 Cooling capacities FWV/FWL/FWM - 4-pipe



32

5-2

5

Air temperature (°C DB - °C WB)		30 - 22															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model		Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
		W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FW.01 FN/FV	Max.	2570	1480	442	33	2380	1410	409	29	2180	1340	374	25	1970	1260	338	20
	Med.	2070	1200	355	23	1920	1140	329	20	1760	1080	302	17	1590	1020	273	14
	Min.	1740	1000	298	17	1610	950	277	15	1480	890	254	12	1340	840	230	10
FW.02 FN/FV	Max.	2990	1810	513	25	2780	1730	476	22	2550	1640	438	19	2320	1560	398	16
	Med.	2580	1530	442	19	2400	1460	412	17	2210	1380	379	15	2010	1310	345	12
	Min.	2090	1230	359	13	1950	1170	334	12	1790	1110	308	10	1630	1050	280	9
FW.03 FN/FV	Max.	4670	2630	802	26	4360	2500	748	23	4030	2370	692	20	3680	2230	632	17
	Med.	3790	2130	650	18	3540	2020	607	16	3280	1910	562	14	2990	1800	514	12
	Min.	2840	1600	487	11	2660	1520	456	10	2460	1440	422	8	2250	1350	387	7
FW.04 FN/FV	Max.	6990	3930	1199	29	6510	3740	1117	25	6010	3540	1032	22	5480	3340	941	18
	Med.	5330	3080	915	18	4970	2930	853	16	4590	2770	789	14	4190	2610	720	12
	Min.	4140	2320	710	11	3860	2200	663	10	3570	2080	613	9	3260	1950	560	7
FW.06 FN/FV	Max.	7650	4470	1312	33	7130	4260	1224	29	6580	4040	1130	25	6000	3820	1031	21
	Med.	6250	3630	1073	23	5830	3450	1001	20	5380	3270	925	18	4920	3090	844	15
	Min.	5130	2920	880	16	4790	2770	822	14	4430	2620	760	13	4040	2470	694	11
FW.08 FN/FV	Max.	10760	6140	1846	28	10050	5840	1724	25	9290	5530	1596	21	8500	5220	1460	18
	Med.	8550	4860	1467	19	7990	4620	1371	17	7390	4370	1269	14	6760	4120	1161	12
	Min.	6580	3680	1127	12	6140	3490	1054	10	5680	3300	975	9	5180	3100	891	8
FW.10 TN/TV	Max.	13770	7840	2362	43	12870	7470	2208	38	11940	7100	2048	33	10910	6710	1874	28
	Med.	10850	6170	1861	28	10130	5870	1738	25	9370	5560	1609	22	8570	5250	1472	18
	Min.	7340	4150	1258	14	6850	3940	1176	13	6340	3730	1089	11	5800	3510	996	9

4TW60012-1 (Sheet 8/13)

DAIKIN

DAIKIN

5 Capacity tables

Heating capacities FWV/FWL/FWM - 4-pipe



Air temperature (°C)		20											
Water temperature (Entering °C - leaving °C)		45 - 40			60 - 50			70 - 60			90 - 70		
Model	Air flow	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
	m ³ /h	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa
FW.01 FN/FV	Max.	1080	188	7	1670	146	5	2230	196	7	2890	128	3
	Med.	920	160	6	1410	124	3	1890	166	5	2470	109	2
	Min.	780	136	4	1210	106	3	1620	142	4	2120	94	2
FW.02 FN/FV	Max.	1010	175	7	1550	135	4	2070	182	6	2690	119	3
	Med.	890	155	5	1370	120	3	1840	161	5	2390	105	2
	Min.	780	135	4	1200	105	3	1610	141	4	2100	93	2
FW.03 FN/FV	Max.	1560	270	5	2380	208	3	2910	286	5	4200	185	2
	Med.	1340	234	4	2060	180	2	2530	249	4	3630	160	2
	Min.	1090	189	3	1670	145	2	2060	202	3	2950	130	1
FW.04 FN/FV	Max.	2200	382	9	3390	296	5	4510	396	8	5870	259	4
	Med.	1820	317	6	2810	246	4	3750	329	6	4890	216	3
	Min.	1500	261	4	2320	203	3	3110	273	4	4060	179	2
FW.06 FN/FV	Max.	2580	448	10	3970	347	6	4670	465	10	6890	304	5
	Med.	2260	393	8	3490	305	5	4100	408	8	6060	268	4
	Min.	1970	343	6	3050	266	4	3560	355	6	5290	234	3
FW.08 FN/FV	Max.	3890	675	28	6020	526	17	7910	694	27	10410	460	12
	Med.	3360	584	21	5210	456	13	6830	600	21	9020	398	10
	Min.	2800	486	16	4350	380	10	5690	499	15	7540	333	7
FW.10 TN/TV	Max.	4560	793	37	7060	617	23	9300	816	36	12210	539	17
	Med.	3910	679	28	6050	529	17	7950	698	27	10470	462	13
	Min.	3010	523	18	4680	409	11	6120	537	17	8100	358	8

4TW60012-1 (Sheet 11/13)

5 Capacity tables

5-2 Heating capacities FWV/FWL/FWM - 4-pipe



34

5-2

5

Air temperature (°C)		22											
Water temperature (Entering °C - leaving °C)		45 - 40			60 - 50			70 - 60			90 - 70		
Model		Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
		W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa
FW.01 FN/FV	Max.	970	169	6	1560	136	4	2120	186	7	2780	123	3
	Med.	820	143	5	1320	115	3	1800	158	5	2370	105	2
	Min.	700	122	3	1130	98	2	1540	135	4	2030	90	2
FW.02 FN/FV	Max.	900	157	5	1440	126	3	1970	173	6	2580	114	3
	Med.	800	139	4	1280	111	3	1750	153	5	2300	101	2
	Min.	700	121	3	1110	97	2	1530	134	4	2010	89	2
FW.03 FN/FV	Max.	1380	240	4	2200	193	3	3090	271	5	4020	177	2
	Med.	1190	208	3	1910	166	2	2690	236	4	3480	154	2
	Min.	960	168	2	1540	135	1	2180	191	3	2820	124	1
FW.04 FN/FV	Max.	1980	344	7	3160	277	5	4290	376	8	5640	249	4
	Med.	1630	284	5	2620	229	3	3560	313	6	4710	208	3
	Min.	1350	234	4	2160	189	2	2960	260	4	3900	172	2
FW.06 FN/FV	Max.	2320	403	9	3710	324	6	5040	442	9	6630	292	4
	Med.	2040	354	7	3260	285	4	4420	387	7	5830	257	3
	Min.	1770	308	5	2840	248	3	3840	337	6	5090	225	3
FW.08 FN/FV	Max.	3510	610	23	5640	493	15	7530	660	24	10020	443	12
	Med.	3040	528	18	4890	427	12	6500	570	19	8680	383	9
	Min.	2530	440	13	4080	356	9	5410	475	14	7260	320	7
FW.10 TN/TV	Max.	4120	717	31	6610	578	20	8850	777	33	11750	519	16
	Med.	3530	614	24	5670	495	16	7570	664	25	10080	445	12
	Min.	2720	473	15	4380	383	10	5820	511	16	7800	344	8

4TW60012-1 (Sheet 12/13)

DAIKIN

DAIKIN

5 Capacity tables

5-3 Cooling capacities FWD - 2-pipe/4-pipe



Air temperature (°C DB - °C WB)		22 - 16															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model	Air flow	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
	m ³ /h	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FWD04	400	1410	1250	241	3	1240	1240	213	2	1150	1150	197	2	1050	1050	180	2
	600	1850	1720	317	5	1590	1590	273	4	1440	1440	247	3	1310	1310	226	2
	800	2370	2200	406	7	2000	2000	343	5	1790	1790	307	4	1570	1570	269	3
FWD06	800	2550	2290	437	5	2190	2190	376	4	2000	2000	343	3	1830	1830	314	3
	1000	3160	2780	542	7	2650	2650	455	5	2360	2360	405	4	2050	2050	352	3
	1250	3810	3320	653	10	3160	3160	543	7	2830	2830	486	6	2490	2490	427	5
FWD08	1200	3470	3470	595	6	3120	3120	535	5	2750	2750	472	4	2500	2500	429	3
	1400	3930	3930	674	7	3550	3550	609	6	3150	3150	541	5	2720	2720	468	4
	1600	4360	4360	748	9	3950	3950	677	7	3520	3520	604	6	3070	3070	528	5
FWD10	1200	3830	3830	657	4	3550	3550	610	3	3280	3280	563	3	3000	3000	515	2
	1400	4320	4320	742	5	3870	3870	663	4	3560	3560	612	3	3260	3260	560	3
	1600	4870	4870	835	6	4380	4380	751	5	3840	3840	660	4	3490	3490	600	3
FWD12	1600	5600	5080	961	7	4660	4660	799	5	4130	4130	709	4	3630	3630	624	3
	1900	6550	5940	1123	9	5380	5380	923	6	4810	4810	825	5	4200	4200	721	4
	2000	6840	6210	1174	10	6050	6050	1038	8	5420	5420	931	7	4770	4770	819	5
FWD16	2000	7760	6650	1331	9	5980	5980	1026	6	5350	5350	919	5	4780	4780	820	4
	2500	9350	8100	1604	13	7190	7190	1233	8	6470	6470	1111	7	5730	5730	984	5
	3000	10790	9460	1851	16	8280	8280	1421	10	7480	7480	1284	8	6660	6660	1144	7
FWD18	2000	9140	7440	1569	13	7490	6750	1286	9	6060	6060	1041	6	5430	5430	932	5
	2500	10930	9070	1875	18	9040	8290	1551	13	7280	7280	1250	9	6540	6540	1124	7
	3000	12570	10630	2156	23	10430	9750	1792	17	8400	8400	1443	11	7560	7560	1298	9

4TW60222-1 (Sheet 1/7)

5 Capacity tables

5-3 Cooling capacities FWD - 2-pipe/4-pipe



36

5-3

5

Air temperature (°C DB - °C WB)		25 - 18															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model	Air flow	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
	m ³ /h	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FWD04	400	2170	1620	371	6	1840	1490	317	5	1460	1350	252	3	1330	1330	227	3
	600	3010	2270	515	11	2590	2110	443	8	2110	1930	364	6	1800	1800	310	4
	800	3740	2860	641	16	3220	2660	554	12	2660	2450	457	9	2240	2240	385	6
FWD06	800	4220	3070	724	12	3630	2840	623	9	2960	2580	508	6	2490	2490	428	5
	1000	5030	3660	968	17	4340	3390	745	13	3580	3100	616	9	2990	2990	511	7
	1250	5980	4330	1026	23	5180	4020	889	17	4310	3690	740	13	3540	3540	609	9
FWD08	1200	6020	4740	1032	15	5180	4410	889	12	3870	3870	666	7	3550	3550	608	6
	1400	6770	5400	1161	19	5840	5040	1004	14	4370	4370	749	9	4010	4010	688	7
	1600	7470	6040	1282	22	6470	5650	1109	17	4830	4830	828	10	4440	4440	763	9
FWD10	1200	6650	5130	1141	10	5640	4720	968	7	4260	4260	731	4	3870	3870	666	4
	1400	7570	5900	1300	12	6470	5460	1109	9	4870	4870	835	6	4450	4450	763	5
	1600	8440	6640	1447	15	7240	6170	1242	11	5450	5450	936	7	4990	4990	857	6
FWD12	1600	8930	6680	1530	16	7730	6200	1328	12	6380	5680	1098	9	5250	5250	904	6
	1900	10220	7720	1753	20	8860	7180	1519	16	7370	6610	1267	11	6030	6030	1037	8
	2200	11420	8710	1958	24	9920	8120	1703	19	8280	7490	1422	14	6760	6760	1159	10
FWD16	2000	11600	8520	1987	18	10180	7950	1746	15	8640	7340	1483	11	6670	6670	1145	7
	2500	13770	10270	2362	25	12120	9610	2077	20	10330	8910	1775	15	7970	7970	1368	9
	3000	15780	11930	2707	32	13890	11180	2383	25	11870	10410	2038	19	9150	9150	1573	12
FWD18	2000	12920	9310	2218	25	11510	8720	1976	20	9990	8110	1714	15	8300	7450	1426	11
	2500	15380	11280	2635	33	13700	10600	2351	27	11900	9880	2045	21	9940	9120	1706	15
	3000	17650	13180	3028	42	15720	12400	2700	34	13670	11590	2347	27	11440	10740	1966	20

4TW60222-1 (Sheet 2/7)

DAIKIN

DAIKIN

5 Capacity tables

5-3 Cooling capacities FWD - 2-pipe/4-pipe



Air temperature (°C DB - °C WB)		27 - 19															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model	Air flow	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
	m ³ /h	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FWD04	400	2580	1870	443	8	2280	1750	392	7	1950	1620	335	5	1570	1480	270	3
	600	3560	2600	608	14	3150	2450	540	12	2720	2290	468	9	2250	2110	385	6
	800	4400	3270	756	21	3900	3080	674	17	3390	2890	583	13	2660	2660	457	9
FWD06	800	4990	3520	857	16	4430	3300	760	13	3830	3070	659	10	3160	2820	544	7
	1000	5920	4180	1015	22	5270	3930	904	18	4570	3660	785	14	3800	3380	652	10
	1250	6970	4940	1195	29	6200	4650	1064	24	5380	4340	924	19	4500	4020	772	13
FWD08	1200	7100	5420	1217	20	6310	5110	1084	17	5460	4790	936	13	4230	4230	727	8
	1400	7970	6160	1368	25	7090	5820	1217	20	6150	5470	1055	16	4760	4760	817	10
	1600	8790	6890	1508	30	7800	6520	1339	24	6800	6130	1166	19	5260	5260	904	12
FWD10	1200	7910	5890	1357	13	6990	5530	1199	11	5990	5140	1026	8	4690	4690	806	5
	1400	8960	6760	1537	17	7950	6360	1364	13	6840	5930	1174	10	5340	5340	918	7
	1600	9970	7600	1710	20	8820	7160	1514	16	7640	6700	1310	12	5950	5950	1022	8
FWD12	1600	10490	7630	1800	21	9350	7170	1606	17	8130	6700	1397	13	6780	6190	1166	10
	1900	11970	8800	2056	26	10690	8290	1832	22	9310	7760	1598	17	7800	7200	1339	12
	2200	13370	9920	2293	32	11900	9360	2056	26	10410	8780	1786	20	8740	8170	1501	15
FWD16	2000	13450	9670	2308	24	12100	9130	2077	20	10660	8560	1829	16	9100	7970	1562	12
	2500	15950	11640	2736	32	14360	11010	2466	27	12670	10360	2178	21	10850	9670	1865	16
	3000	18260	13510	3136	41	16400	12800	2833	34	14520	12060	2491	27	12450	11290	2138	21
FWD18	2000	14790	10490	2538	31	13430	9930	2304	26	11990	9350	2059	21	10440	8740	1793	17
	2500	17610	12710	3020	42	15990	12050	2743	35	14270	11370	2448	29	12430	10660	2135	23
	3000	20150	14820	3456	53	18300	14100	3140	45	16370	13320	2812	37	14270	12520	2452	29

4TW60222-1 (Sheet 3/7)

5 Capacity tables

5-4 Heating capacities FWD - 2-pipe



38

5-4

5

Air temperature (°C)		20											
Water temperature (Entering °C - leaving °C)		50 - 45			60 - 50			70 - 60			90 - 70		
Model	Air flow	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
	m ³ /h	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa
FWD04TN	400	3010	526	9	3830	335	4	4970	436	6	6660	295	3
	600	4070	709	15	5160	450	7	6700	587	10	8940	396	5
	800	4990	871	22	6300	551	9	8200	720	15	10910	482	7
FWD06TN	800	5760	1004	18	7320	641	8	9490	832	12	12690	562	6
	1000	6790	1181	23	8600	752	10	11170	979	16	14900	659	7
	1250	7960	1386	31	10050	878	13	13080	1147	21	17400	768	10
FWD08TN	1200	7920	1379	21	10030	878	9	13030	1145	14	17370	767	7
	1400	8830	1541	25	11170	976	11	14520	1274	17	19320	853	8
	1600	9690	1688	29	12220	1069	13	15920	1397	20	21150	932	9
FWD10TN	1200	8940	1559	14	11380	994	6	14730	1292	9	19730	871	4
	1400	10040	1750	17	12740	1112	7	16530	1451	11	22090	976	5
	1600	11080	1930	20	14040	1228	9	18230	1598	13	24330	1073	6
FWD12TN	1600	11760	2048	21	14960	1307	9	19380	1699	14	25930	1145	7
	1900	13350	2326	27	16930	1480	12	21970	1930	18	29340	1296	9
	2200	14830	2585	32	18770	1638	14	24400	2142	21	32520	1436	10
FWD16TN	2000	15010	2617	24	19180	1678	11	24740	2171	16	33240	1465	8
	2500	17750	3092	32	22600	1976	14	29220	2563	22	39140	1728	10
	3000	20270	3528	41	25760	2250	18	33350	2927	27	44570	1966	13
FWD18TN	2000	16300	2837	31	20970	1832	14	26890	2358	21	36350	1606	10
	2500	19430	3384	42	24930	2178	19	32040	2812	28	43180	1904	14
	3000	22340	3892	53	28590	2498	24	36810	3229	36	49510	2185	17

4TW60222-1 (Sheet 4/7)

DAIKIN

DAIKIN

5 Capacity tables

5-4 Heating capacities FWD - 2-pipe



Air temperature (°C)		22											
Water temperature (Entering °C - leaving °C)		50 - 45			60 - 50			70 - 60			90 - 70		
Model	Air flow	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
	m ³ /h	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa
FWD04TN	400	2780	486	8	3590	313	4	4730	415	6	6410	283	3
	600	3760	655	13	4840	423	6	6380	560	9	8600	380	5
	800	4610	803	19	5910	517	8	7810	685	13	10500	463	6
FWD06TN	800	5320	929	15	6870	624	7	9040	793	11	12230	540	5
	1000	6270	1091	20	8070	705	9	10630	933	14	14340	633	7
	1250	7340	1279	27	9430	824	12	12450	1092	19	16750	739	9
FWD08TN	1200	7310	1274	18	9420	823	8	12410	1089	13	16730	739	6
	1400	8830	1541	25	10480	915	10	13830	1213	15	18610	821	7
	1600	9690	1688	29	11470	1002	11	15150	1330	18	20370	899	9
FWD10TN	1200	8250	1436	12	10680	933	5	14030	1230	8	19000	839	4
	1400	9270	1614	15	11960	1045	7	15740	1381	10	21720	939	5
	1600	10220	1781	17	13170	1151	8	17350	1523	12	23420	1034	6
FWD12TN	1600	10860	1892	19	14040	1227	8	18440	1619	13	24980	1102	6
	1900	12320	2146	23	15890	1388	10	20920	1835	16	28250	1247	8
	2200	13690	2384	28	17610	1539	13	23220	2038	20	31310	1382	10
FWD16TN	2000	13870	2416	21	18020	1574	10	23560	2067	15	32010	1414	7
	2500	16390	2855	28	21320	1855	13	27820	2442	20	37710	1664	10
	3000	18720	3260	35	24190	2113	16	31750	2787	25	42930	1896	12
FWD18TN	2000	15060	2624	27	19710	1722	12	25610	2248	19	35030	1546	9
	2500	17960	3129	36	23420	2047	17	30520	2677	26	41600	1837	13
	3000	20650	3598	46	26870	2347	21	35060	3077	33	47700	2106	16

4TW60222-1 (Sheet 5/7)

5 Capacity tables

5-5 Heating capacities FWD - 4-pipe



40

5-5

5

Air temperature (°C)		20											
Water temperature (Entering °C - leaving °C)		50 - 45			60 - 50			70 - 60			90 - 70		
Model	Air flow	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
	m ³ /h	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa
FWD04FN	400	1950	338	7	2370	209	3	3190	281	5	4150	184	2
	600	2390	418	11	2930	256	4	3920	346	7	5090	223	3
	800	2740	479	13	3360	292	6	4490	396	9	5820	256	4
FWD06FN	800	3280	569	16	4060	356	7	5370	472	10	7030	310	5
	1000	3650	634	19	4510	392	8	5970	526	13	7800	346	6
	1250	4040	704	22	4990	436	9	6620	581	15	8620	381	7
FWD08FN	1200	4900	853	15	6040	526	6	8030	706	10	10460	461	5
	1400	5280	918	17	6490	569	7	8650	760	12	11250	497	5
	1600	5620	979	19	6900	605	8	9210	806	13	11960	529	6
FWD10FN	1200	4900	853	15	6040	526	6	8030	706	10	10460	461	5
	1400	5280	918	17	6490	569	7	8650	760	12	11250	497	5
	1600	5620	979	19	6900	605	8	9210	806	13	11960	529	6
FWD12FN	1600	7930	1382	13	9880	864	5	13020	1141	9	17110	756	4
	1900	8840	1541	15	10990	961	7	14500	1271	10	19020	839	5
	2200	9670	1685	18	12010	1051	8	15860	1393	12	20790	918	6
FWD16FN	2000	10020	1746	15	12540	1094	6	16450	1444	10	21690	958	5
	2500	11530	2009	19	14400	1260	8	18920	1660	13	24900	1098	6
	3000	12900	2246	23	16080	1404	10	21150	1854	16	27790	1228	7
FWD18FN	2000	10020	1746	15	12540	1094	6	16450	1444	10	21690	958	5
	2500	11530	2009	19	14400	1260	8	18920	1660	13	24900	1098	6
	3000	12900	2246	23	16080	1404	10	21150	1854	16	27790	1228	7

4TW60222-1 (Sheet 6/7)

DAIKIN

DAIKIN

5 Capacity tables

5-5 Heating capacities FWD - 4-pipe



Air temperature (°C)		22											
Water temperature (Entering °C - leaving °C)		50 - 45			60 - 50			70 - 60			90 - 70		
Model	Air flow	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
	m ³ /h	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa
FWD04FN	400	1790	313	6	2210	194	3	3030	266	4	3990	176	2
	600	2200	385	9	2730	238	4	3730	328	6	4900	216	3
	800	2520	439	12	3130	274	5	4270	374	8	5590	248	4
FWD06FN	800	3020	526	13	3800	331	6	5110	446	10	6760	299	4
	1000	3360	587	16	4220	367	7	5680	500	11	7510	331	5
	1250	3720	648	19	4670	408	8	6290	552	14	8300	366	6
FWD08FN	1200	4510	785	13	5640	493	6	7630	670	9	10060	443	4
	1400	4860	846	15	6070	529	6	8220	720	11	10820	479	5
	1600	5170	900	17	6450	565	7	8750	767	12	11500	508	6
FWD10FN	1200	4510	785	13	5640	493	6	7630	670	9	10060	443	4
	1400	4860	846	15	6070	529	6	8220	720	11	10820	479	5
	1600	5170	900	17	6450	565	7	8750	767	12	11500	508	6
FWD12FN	1600	7310	1274	11	9250	810	5	12380	1087	8	16460	727	4
	1900	8140	1418	13	6970	608	8	13790	1210	9	18310	806	4
	2200	8910	1552	16	11250	983	7	15090	1325	11	20010	882	5
FWD16FN	2000	9240	1609	13	11760	1026	6	15650	1372	9	20880	922	4
	2500	10630	1854	17	13490	1177	7	18000	1580	12	23970	1058	6
	3000	11890	2070	20	15070	1318	9	20130	1764	14	26760	1181	7
FWD18TN	2000	9240	1609	13	11760	1026	6	15650	1372	9	20880	922	4
	2500	10630	1854	17	13490	1177	7	18000	1580	12	23970	1058	6
	3000	11890	2070	20	15070	1318	9	20130	1764	14	26760	1181	7

4TW60222-1 (Sheet 7/7)

5 Capacity tables

5-6 Cooling capacities FWB - 2-pipe



42

5-6

5

Air temperature (°C DB - °C WB)		25 - 18															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model	Air flow	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
	m ³ /h	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FWB02	300	1900	1350	326	4	1590	1230	273	3	1410	1150	242	3	1230	1080	211	2
	400	2490	1750	427	7	2130	1610	366	5	1710	1440	294	4	1400	1330	240	3
	500	3020	2120	517	10	2610	1960	448	8	2150	1770	368	5	1760	1760	303	4
FWB03	300	2320	1560	398	8	2060	1440	353	6	1760	1320	302	5	1460	1200	250	3
	400	3020	2030	518	13	2690	1890	461	10	2320	1730	398	8	1890	1560	325	6
	500	3670	2470	630	18	3270	2300	561	15	2830	2120	487	11	2340	1920	402	8
FWB04	300	2540	1670	436	6	2270	1550	390	5	2000	1430	344	4	1770	1340	304	3
	400	3360	2210	576	10	3020	2060	518	8	2640	1890	453	7	2190	1710	377	5
	500	4140	2740	710	15	3730	2550	639	12	3270	2350	561	10	2750	2140	473	7
FWB05	600	3810	2650	653	9	3300	2440	566	7	2700	2210	464	5	2170	2170	372	3
	800	4870	3370	834	14	4250	3120	729	11	3560	2850	611	8	2710	2530	465	5
	1000	5830	4020	1000	19	5100	3730	875	15	4300	3420	739	11	3380	3070	581	7
FWB06	600	3870	2740	663	4	3280	2500	562	3	2910	2350	499	3	2530	2200	434	2
	800	5180	3610	889	7	4410	3290	757	5	3360	2870	577	3	2870	2690	493	2
	1000	6360	4380	1091	10	5480	4020	940	8	4450	3610	763	5	3680	3680	632	4
FWB07	600	4770	3180	817	8	4230	2940	727	7	3620	2680	622	5	3050	2450	523	4
	800	6230	4150	1069	13	5560	3860	955	11	4830	3550	829	9	3970	3200	681	6
	1000	7600	5070	1304	19	6800	4720	1167	16	5920	4350	1017	12	4930	3950	847	9
FWB08	1000	6250	4250	1072	15	5470	3930	939	12	4600	3590	790	9	3540	3180	607	5
	1200	7260	4910	1245	19	6370	4550	1093	15	5390	4160	926	11	4260	3730	732	7
	1400	8200	5510	1406	24	7210	5110	1237	19	6130	4690	1052	14	4900	4220	841	9
FWB09	1000	7120	4800	1220	15	6290	4450	1080	12	5380	4080	923	9	4280	3640	736	6
	1200	8330	5610	1428	19	7380	5210	1267	16	6340	4780	1089	12	5150	4310	884	8
	1400	9480	6370	1626	24	8410	5920	1443	19	7240	5440	1244	15	5930	4930	1019	10
FWB10	1000	8430	5530	1446	19	7610	5150	1306	15	6710	4760	1153	12	5690	4330	979	9
	1200	9970	6540	1711	25	9010	6100	1546	21	7960	5640	1367	17	6790	5150	1166	12
	1400	11470	7510	1967	32	10360	7010	1778	26	9160	6490	1572	21	7830	5940	1345	16

4TW60292-1 (Sheet 1/6)

DAIKIN

DAIKIN

5 Capacity tables

5-6 Cooling capacities FWB - 2-pipe



DAIKIN

DAIKIN

Air temperature (°C DB - °C WB)		27 - 19															
Water temperature (Entering °C - leaving °C)		6 - 11				7 - 12				8 - 13				9 - 14			
Model	Air flow	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop	Total cooling capacity	Sensible cooling capacity	Water flow	Water pressure drop
	m ³ /h	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa	W	W	ℓ/h	kPa
FWB02	300	2260	1560	388	6	2010	1460	345	5	1710	1340	293	4	1440	1230	247	3
	400	2920	2010	501	9	2610	1880	448	8	2250	1740	386	6	1840	1580	315	4
	500	3530	2430	605	13	3160	2270	542	11	2740	2110	470	8	2270	1930	390	6
FWB03	300	2660	1760	456	10	2420	1660	415	9	2150	1540	369	7	1840	1420	317	5
	400	3450	2290	591	16	3140	2160	539	14	2790	2010	479	11	2420	1860	416	8
	500	4190	2790	719	23	3820	2630	655	19	3400	2450	583	15	2950	2270	507	12
FWB04	300	2880	1880	494	8	2640	1770	453	7	2370	1650	407	6	2050	1520	353	4
	400	3790	2490	651	13	3490	2340	598	11	3130	2190	538	9	2750	2030	472	7
	500	4680	3070	802	18	4290	2890	737	16	3860	2700	663	13	3400	2510	584	10
FWB05	600	4460	3030	765	12	3990	2840	685	10	3480	2630	597	8	2890	2410	497	6
	800	5670	3840	972	18	5080	3600	873	15	4460	3350	765	12	3760	3090	646	9
	1000	6780	4580	1162	25	6080	4300	1044	21	5340	4010	918	16	4540	3700	779	12
FWB06	600	4680	3200	804	6	4120	2960	706	5	3420	2680	587	3	2970	2510	510	3
	800	6130	4150	1053	9	5450	3870	936	8	4690	3560	805	6	3750	3200	644	4
	1000	7470	5020	1282	13	6670	4680	1144	11	5780	4330	993	8	4770	3940	820	6
FWB07	600	5450	3590	935	11	4960	3370	852	9	4430	3140	760	7	3830	2890	657	6
	800	7100	4680	1218	17	6470	4400	1111	14	5800	4110	995	12	5060	3810	868	9
	1000	8660	5700	1486	24	7900	5370	1355	20	7080	5020	1215	17	6190	4660	1063	13
FWB08	1000	7260	4840	1245	19	6530	4540	1120	16	5740	4230	985	13	4870	3890	836	9
	1200	8410	5580	1444	25	7570	5230	1299	21	6670	4880	1145	16	5680	4500	976	12
	1400	9500	6260	1630	31	8550	5880	1468	25	7540	5480	1295	20	6440	5070	1107	15
FWB09	1000	8190	5440	1404	19	7410	5110	1272	16	6580	4760	1129	13	5660	4390	972	10
	1200	9570	6350	1642	25	8670	5960	1488	21	7710	5570	1323	17	6650	5150	1143	13
	1400	10890	7200	1868	31	9860	6770	1693	26	8770	6320	1507	21	7590	5860	1304	16
FWB10	1000	9510	6190	1632	23	8740	5830	1500	20	7900	5460	1358	16	7000	5080	1202	13
	1200	11260	7320	1931	31	10340	6900	1774	26	9350	6470	1606	22	8290	6020	1423	18
	1400	12950	8410	2221	39	11890	7930	2039	34	10750	7430	1846	28	9530	6920	1636	23

4TW60292-1 (Sheet 2/6)

5 Capacity tables

5-7 Heating capacities FWB - 2-pipe



44

5-7

5

Air temperature (°C)		20 - 22											
Water temperature (Entering °C - leaving °C)		50 - 45			60 - 50			70 - 60			90 - 70		
Model	Air flow	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
	m ³ /h	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa
FWB02	300	2230	388	5	3450	301	3	4420	388	5	5950	263	2
	400	2830	493	8	4370	382	5	5600	491	7	7520	332	3
	500	3380	588	10	5220	456	6	6690	587	9	8950	395	5
FWB03	300	2420	421	7	3770	329	5	4770	419	7	6500	287	3
	400	3120	543	11	4850	424	7	6150	540	10	8340	368	5
	500	3780	657	16	5860	512	10	7450	654	14	10070	444	7
FWB04	300	2560	445	5	4010	350	3	5040	442	5	6930	306	2
	400	3360	585	9	5260	460	5	6620	581	8	9080	401	4
	500	4140	720	12	6460	565	8	8150	715	11	11140	492	6
FWB05	600	4250	739	9	6580	574	6	8400	737	9	11290	498	4
	800	5340	928	14	8230	719	8	10550	926	13	14110	623	6
	1000	6330	1100	19	9740	851	11	12520	1098	17	16680	737	8
FWB06	600	4610	802	5	7150	624	3	9140	802	4	12340	545	2
	800	5900	1026	7	9130	798	5	11660	1023	7	15690	692	3
	1000	7080	1231	10	10940	955	6	14000	1229	9	18770	829	4
FWB07	600	4930	856	8	7680	671	5	9710	852	7	13260	585	3
	800	6380	1110	12	9930	868	7	12570	1103	11	17090	755	5
	1000	7750	1348	17	12040	1053	10	15280	1341	15	20710	914	7
FWB08	1000	6770	1177	14	10450	913	9	13380	1174	13	17920	791	6
	1200	7790	1355	18	12010	1049	11	15400	1351	17	20570	908	8
	1400	8750	1522	22	13470	1177	14	17310	1518	20	23070	1018	10
FWB09	1000	7520	1307	14	11660	1018	8	14820	1301	12	20020	884	6
	1200	8740	1520	18	13540	1183	11	17250	1514	16	23240	1026	8
	1400	9910	1723	22	15320	1339	13	19570	1717	20	26290	1160	10
FWB10	1000	8270	1439	15	12920	1129	9	16280	1429	14	22270	983	7
	1200	9770	1698	20	15230	1330	13	19220	1687	18	26230	1157	9
	1400	11210	1948	26	17450	1525	16	22070	1936	23	30030	1326	11

4TW60292-1 (Sheet 3/6)

DAIKIN

DAIKIN

5 Capacity tables

5-7 Heating capacities FWB - 2-pipe



Air temperature (°C)		20 - 22											
Water temperature (Entering °C - leaving °C)		50 - 45			60 - 50			70 - 60			90 - 70		
Model	Air flow	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
	m ³ /h	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa
FWB02	300	2130	370	5	3350	292	3	4320	379	4	5840	258	2
	400	2700	470	7	4240	371	4	5470	480	7	7380	326	3
	500	3230	562	10	5060	442	6	6530	573	9	8780	388	4
FWB03	300	2310	402	7	3660	320	4	4660	409	6	6380	282	3
	400	2980	519	11	4710	412	7	6010	527	10	8190	362	5
	500	3610	628	15	5690	497	9	7280	638	14	9890	436	7
FWB04	300	2450	426	5	3890	340	3	4930	432	5	6810	301	2
	400	3220	560	8	5110	446	5	6470	567	8	8920	394	4
	500	3960	689	12	6280	549	7	7960	698	11	10940	483	5
FWB05	600	4060	707	9	5820	508	8	8200	720	8	11080	489	4
	800	5100	886	13	7990	698	8	10310	904	12	13860	612	6
	1000	6040	1051	17	9450	826	11	12220	1072	16	16380	723	8
FWB06	600	4410	766	4	6610	578	12	8920	783	4	12110	535	2
	800	5640	980	7	8850	774	4	11390	999	7	15400	680	3
	1000	6760	1176	9	10610	927	6	13680	1199	9	18430	814	4
FWB07	600	4710	819	7	7400	646	10	9480	832	7	13020	575	3
	800	6110	1062	11	9650	843	7	12280	1077	10	16790	741	5
	1000	7410	1290	15	11700	1022	10	14920	1309	15	20340	898	7
FWB08	1000	6470	1125	13	10140	886	8	13060	1146	13	17590	776	6
	1200	7440	1294	17	11650	1018	11	15050	1319	16	20200	892	8
	1400	8360	1453	21	13070	1142	13	16900	1483	20	22650	1000	9
FWB09	1000	7190	1249	13	11320	988	8	14480	1271	12	19660	868	6
	1200	8360	1453	16	13140	1148	10	16850	1479	15	22810	1007	8
	1400	9470	1646	20	14870	1300	13	19110	1676	19	25810	1140	9
FWB10	1000	7920	1377	14	12550	1097	9	15900	1395	13	21880	965	7
	1200	9340	1625	19	14790	1292	12	18780	1647	18	25760	1137	9
	1400	10720	1864	24	16950	1481	15	21550	1891	22	29490	1302	11

4TW60292-1 (Sheet 4/6)

5 Capacity tables

5-8 Heating capacities FWB - Additional heat exchanger



46

5-8

5

Air temperature (°C)		19											
Water temperature (Entering °C - leaving °C)		50 - 45			60 - 50			70 - 60			90 - 70		
Model	Air flow	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
	m ³ /h	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa
EAH04A6	300	1350	236	3	2050	179	2	2750	241	3	3550	157	1
	400	1590	277	4	2410	211	2	3220	282	4	4160	184	2
	500	1790	312	5	2710	237	3	3610	317	4	4670	206	2
EAH07A6	600	2630	457	4	3990	348	3	5270	462	4	6870	303	2
	800	3070	533	6	4660	408	3	6140	538	5	7980	352	2
	1000	3430	596	7	5210	455	4	6870	602	7	8900	393	3
EAH10A6	1000	5800	1009	7	8900	778	4	11520	1011	6	15250	673	3
	1200	6610	1149	9	10120	885	5	13120	1150	8	17330	765	4
	1400	7350	1278	11	11260	984	6	14600	1281	10	19260	850	5

4TW60292-1 (Sheet 5/6)

DAIKIN

DAIKIN

5 Capacity tables

5-8 Heating capacities FWB - Additional heat exchanger



Air temperature (°C)		20											
Water temperature (Entering °C - leaving °C)		50 - 45			60 - 50			70 - 60			90 - 70		
Model	Air flow	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop	Heating capacity	Water flow	Water pressure drop
	m ³ /h	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa	W	ℓ/h	kPa
EAH04A6	300	1290	224	3	1980	173	2	2680	235	3	3480	153	1
	400	1510	263	3	2330	203	2	3140	275	3	4080	180	2
	500	1700	296	4	2620	229	3	3520	309	4	4580	202	2
EAH07A6	600	2500	434	4	3860	337	2	5140	451	4	6740	298	2
	800	2920	508	5	4510	394	3	5990	526	5	7830	346	2
	1000	3270	568	7	5040	441	4	6700	588	6	8740	386	3
EAH10A6	1000	5540	963	6	8620	753	4	11250	986	6	11250	986	6
	1200	6310	1096	8	9820	858	5	12800	1123	8	12800	1123	8
	1400	7020	1220	10	10910	954	6	14260	1250	9	14260	1250	9

4TW60292-1 (Sheet 6/6)



6-1 6

6 Correction factors

6-1 Correction factors for cooling & heating capacities

48

DAIKIN

DAIKIN

6-1-1 FWV-FWL-FWM

	ESP	10		20		30		40		50		60	
	Fan speed	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2
FW..01	Max.	0.86	0.91	0.72	0.8	0.56	0.67	-	-	-	-	-	-
	Med.	0.78	0.84	0.56	0.65	0.33	0.41	-	-	-	-	-	-
	Min.	0.71	0.77	0.35	0.4	-	-	-	-	-	-	-	-
FW..02	Max.	0.85	0.89	0.73	0.78	0.61	0.67	0.5	0.57	0.4	0.47	0.31	0.36
	Med.	0.82	0.85	0.63	0.68	0.45	0.5	0.27	0.3	-	-	-	-
	Min.	0.78	0.8	0.55	0.59	0.35	0.37	-	-	-	-	-	-
FW..03	Max.	0.89	0.91	0.77	0.81	0.64	0.69	0.51	0.56	0.36	0.4	0.18	0.21
	Med.	0.82	0.84	0.64	0.67	0.47	0.5	0.29	0.32	-	-	-	-
	Min.	0.75	0.77	0.48	0.5	-	-	-	-	-	-	-	-
FW..04	Max.	0.93	0.95	0.85	0.89	0.77	0.82	0.67	0.73	0.56	0.63	0.42	0.5
	Med.	0.91	0.93	0.81	0.84	0.71	0.75	0.59	0.64	0.46	0.51	0.31	0.35
	Min.	0.84	0.86	0.68	0.71	0.52	0.55	0.34	0.36	-	-	-	-
FW..06	Max.	0.93	0.95	0.85	0.89	0.77	0.81	0.67	0.73	0.56	0.62	0.41	0.47
	Med.	0.92	0.93	0.82	0.86	0.73	0.77	0.61	0.66	0.48	0.53	0.31	0.36
	Min.	0.86	0.88	0.71	0.74	0.56	0.59	0.4	0.43	0.23	0.25	-	-
FW..08	Max.	0.96	0.96	0.91	0.92	0.86	0.88	0.8	0.83	0.74	0.78	0.67	0.71
	Med.	0.95	0.96	0.9	0.92	0.85	0.87	0.79	0.81	0.73	0.76	0.65	0.69
	Min.	0.91	0.92	0.81	0.82	0.71	0.73	0.6	0.62	0.49	0.51	0.37	0.39
FW..10	Max.	0.96	0.97	0.92	0.93	0.87	0.89	0.82	0.85	0.77	0.81	0.72	0.76
	Med.	0.95	0.96	0.9	0.91	0.84	0.86	0.78	0.81	0.71	0.75	0.64	0.68
	Min.	0.92	0.93	0.84	0.86	0.76	0.78	0.67	0.69	0.57	0.6	0.47	0.5

		FW..01		FW..02		FW..03		FW..04		FW..06		FW..08		FW..10	
		medium	low	medium	low	medium	low	medium	low	medium	low	medium	low	medium	low
Total cooling capacity	TCC	0.81	0.68	0.87	0.69	0.81	0.60	0.76	0.58	0.81	0.66	0.79	0.59	0.78	0.52
Sensible cooling capacity	SCC	0.81	0.66	0.87	0.70	0.81	0.60	0.78	0.57	0.80	0.64	0.78	0.58	0.77	0.51
Heating capacity - 2 pipe	HC2P	0.81	0.66	0.83	0.68	0.81	0.59	0.76	0.58	0.82	0.66	0.79	0.61	0.78	0.52
Heating capacity - 4 pipe	HC40	0.85	0.73	0.89	0.78	0.87	0.71	0.83	0.69	0.88	0.76	0.86	0.72	0.85	0.66

4TW60018-1

Conditions

Cooling Air: 27°C DB - 19°C WB - Water: entering 7°C - leaving 12°C
 Heating 2-pipe Air: 20°C Water: entering 50°C water flow as for cooling
 Heating 4-pipe Air: 20°C Water: entering 70°C - leaving 60°C

F1 = correction factor for air flow
 F2 = correction factor for capacities

Correction factors are based on an average value. This can cause deviation depending on conditions used. The Fan Coil Selection software will provide an accurate result at all conditions.



6 Correction factors

6-1 Correction factors for cooling & heating capacities

6-1-2 FWD

	ESP (Pa)	0		20		40		60		80		100		120		140		160		180		200		220		240			
		Fan speed	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	
FWD04	Max.	1.18	1.13	1.13	1.09	1.08	1.06	1.02	1.02	0.96	0.97	0.89	0.92	0.8	0.85	0.7	0.77	0.53	0.62	-	-	-	-	-	-	-	-	-	-
	Med.	1.34	1.24	1.28	1.2	1.21	1.15	1.13	1.1	1.04	1.03	0.95	0.96	0.82	0.86	0.65	0.71	-	-	-	-	-	-	-	-	-	-	-	
	Min.	1.44	1.34	1.37	1.29	1.29	1.23	1.2	1.16	1.1	1.08	0.97	0.98	0.79	0.82	-	-	-	-	-	-	-	-	-	-	-	-	-	
FWD06	Max.	1.26	1.19	1.18	1.13	1.09	1.07	0.99	0.99	0.88	0.91	0.75	0.81	0.6	0.68	0.4	0.48	-	-	-	-	-	-	-	-	-	-	-	
	Med.	1.37	1.26	1.28	1.2	1.19	1.13	1.08	1.06	0.97	0.97	0.83	0.87	0.67	0.73	0.44	0.5	-	-	-	-	-	-	-	-	-	-	-	
	Min.	1.47	1.34	1.38	1.28	1.28	1.21	1.17	1.13	1.04	1.03	0.9	0.92	0.72	0.77	0.45	0.5	-	-	-	-	-	-	-	-	-	-	-	
FWD08	Max.	1.28	1.2	1.21	1.15	1.13	1.09	1.04	1.03	0.94	0.96	0.83	0.88	0.71	0.77	0.55	0.63	0.3	0.36	-	-	-	-	-	-	-	-	-	
	Med.	1.18	1.13	1.11	1.08	1.03	1.02	0.94	0.96	0.85	0.88	0.74	0.79	0.61	0.68	0.42	0.49	-	-	-	-	-	-	-	-	-	-	-	
	Min.	1.15	1.11	1.08	1.06	1.00	1.00	0.91	0.93	0.82	0.85	0.7	0.75	0.56	0.62	0.35	0.41	-	-	-	-	-	-	-	-	-	-	-	
FWD10	Max.	1.26	1.2	1.18	1.14	1.1	1.08	1.02	1.02	0.92	0.94	0.82	0.85	0.7	0.74	0.54	0.6	0.31	0.38	-	-	-	-	-	-	-	-	-	
	Med.	1.17	1.14	1.1	1.08	1.02	1.02	0.94	0.95	0.84	0.87	0.73	0.77	0.6	0.64	0.41	0.46	-	-	-	-	-	-	-	-	-	-	-	
	Min.	1.14	1.12	1.07	1.06	0.99	0.99	0.91	0.92	0.81	0.83	0.7	0.72	0.56	0.57	0.35	0.43	-	-	-	-	-	-	-	-	-	-	-	
FWD12	Max.	1.35	1.24	1.29	1.21	1.22	1.16	1.15	1.11	1.07	1.06	0.99	0.99	0.89	0.92	0.77	0.82	0.61	0.68	-	-	-	-	-	-	-	-	-	
	Med.	1.16	1.12	1.1	1.08	1.03	1.03	0.96	0.97	0.88	0.91	0.79	0.83	0.69	0.74	0.56	0.62	0.35	0.4	-	-	-	-	-	-	-	-	-	
	Min.	1.02	1.02	0.96	0.97	0.89	0.91	0.82	0.85	0.74	0.78	0.65	0.7	0.54	0.59	0.39	0.43	-	-	-	-	-	-	-	-	-	-	-	
FWD16	Max.	1.13	1.1	1.12	1.09	1.1	1.07	1.08	1.06	1.06	1.05	1.04	1.04	1.03	1.02	1.01	1.01	0.98	0.99	0.96	0.98	0.94	0.96	0.92	0.94	0.89	0.92		
	Med.	1.11	1.08	1.09	1.07	1.07	1.05	1.04	1.03	1.02	1.02	1.00	1.00	0.97	0.98	0.95	0.96	0.92	0.94	0.89	0.92	0.86	0.89	0.83	0.86	0.79	0.84		
	Min.	1.09	1.07	1.06	1.05	1.03	1.03	1.01	1.01	0.98	0.99	0.95	0.96	0.92	0.94	0.89	0.91	0.86	0.88	0.82	0.85	0.78	0.82	0.74	0.78	0.69	0.74		
FWD18	Max.	1.12	1.09	1.11	1.08	1.09	1.06	1.07	1.05	1.05	1.04	1.03	1.03	1.01	1.01	0.99	1.00	0.97	0.98	0.95	0.97	0.93	0.95	0.91	0.93	0.88	0.91		
	Med.	1.1	1.07	1.07	1.06	1.05	1.04	1.03	1.02	1.01	1.01	0.98	0.99	0.96	0.97	0.93	0.95	0.9	0.92	0.87	0.9	0.84	0.88	0.81	0.85	0.78	0.82		
	Min.	1.08	1.06	1.05	1.04	1.03	1.02	1.00	1.00	0.97	0.98	0.94	0.95	0.91	0.93	0.88	0.9	0.84	0.87	0.81	0.84	0.77	0.81	0.72	0.77	0.67	0.72		

4TW60228-1A

Conditions

Cooling
 Heating 2-pipe
 Heating 4-pipe

Air: 27°C DB - 19°C WB - Water: entering 7°C - leaving 12°C
 Air: 20°C Water: entering 50°C water flow as for cooling
 Air: 20°C Water: entering 70°C - leaving 60°C

F1 = correction factor for air flow
 F2 = correction factor for capacities

The correction factor is applicable also for 4 pipe and heating mode because the differences are negligible.



6 Correction factors

6-1 Correction factors for cooling & heating capacities

6-1-3 FWB

	ESP (Pa)	10		20		30		40		50		60		70		80		90		
		Fan speed	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2	F1	F2
FWB02	Min. (1)	0.83	0.85	0.67	0.74	0.51	0.62	0.35	0.46											
	Med. (4)	0.91	0.92	0.82	0.84	0.73	0.76	0.64	0.66	0.56	0.59	0.47	0.53	0.38	0.46	0.29	0.38	0.21	0.29	
	Max. (7)	0.95	0.96	0.89	0.91	0.83	0.86	0.78	0.82	0.72	0.77	0.66	0.71	0.61	0.66	0.55	0.60	0.49	0.54	
FWB03	Min. (1)	0.83	0.84	0.67	0.69	0.51	0.56	0.35	0.40											
	Med. (4)	0.91	0.92	0.82	0.84	0.73	0.75	0.64	0.67	0.56	0.58	0.47	0.49	0.38	0.42	0.29	0.34	0.21	0.25	
	Max. (7)	0.95	0.95	0.89	0.91	0.83	0.86	0.78	0.81	0.72	0.76	0.66	0.71	0.61	0.65	0.55	0.59	0.49	0.53	
FWB04	Min. (1)	0.83	0.84	0.67	0.70	0.51	0.55	0.35	0.39											
	Med. (4)	0.91	0.91	0.82	0.83	0.73	0.74	0.64	0.65	0.56	0.57	0.47	0.50	0.38	0.42	0.29	0.33	0.21	0.24	
	Max. (7)	0.95	0.95	0.89	0.90	0.83	0.85	0.78	0.80	0.72	0.74	0.66	0.69	0.61	0.63	0.55	0.57	0.49	0.51	
FWB05	Min. (1)	0.88	0.88	0.76	0.77	0.64	0.69	0.53	0.61	0.42	0.51	0.31	0.40							
	Med. (4)	0.96	0.96	0.91	0.93	0.86	0.89	0.82	0.84	0.76	0.80	0.71	0.75	0.65	0.69	0.59	0.63	0.53	0.57	
	Max. (7)	0.96	0.97	0.92	0.93	0.87	0.90	0.83	0.86	0.78	0.82	0.73	0.78	0.68	0.74	0.63	0.69	0.58	0.65	
FWB06	Min. (1)	0.88	0.92	0.76	0.83	0.64	0.74	0.53	0.64	0.42	0.53	0.31	0.40							
	Med. (4)	0.96	0.96	0.91	0.91	0.86	0.87	0.82	0.82	0.76	0.76	0.71	0.70	0.65	0.65	0.59	0.61	0.53	0.57	
	Max. (7)	0.96	0.96	0.92	0.93	0.87	0.89	0.83	0.85	0.78	0.80	0.73	0.76	0.68	0.71	0.63	0.66	0.58	0.61	
FWB07	Min. (1)	0.88	0.90	0.76	0.81	0.64	0.70	0.53	0.60	0.42	0.48	0.31	0.36							
	Med. (4)	0.96	0.96	0.91	0.92	0.86	0.87	0.82	0.83	0.76	0.78	0.71	0.73	0.65	0.67	0.59	0.61	0.53	0.54	
	Max. (7)	0.96	0.96	0.92	0.93	0.87	0.89	0.83	0.85	0.78	0.81	0.73	0.76	0.68	0.71	0.63	0.67	0.58	0.62	
FWB08	Min. (1)	0.91	0.92	0.81	0.83	0.71	0.73	0.60	0.62	0.48	0.51	0.35	0.41							
	Med. (4)	0.93	0.94	0.85	0.88	0.77	0.81	0.68	0.73	0.59	0.64	0.49	0.54	0.38	0.42	0.25	0.31			
	Max. (7)	0.95	0.96	0.89	0.92	0.84	0.88	0.77	0.83	0.71	0.77	0.64	0.71	0.57	0.64	0.49	0.57	0.40	0.48	
FWB09	Min. (1)	0.91	0.92	0.81	0.82	0.71	0.72	0.60	0.61	0.48	0.51	0.35	0.40							
	Med. (4)	0.93	0.94	0.85	0.87	0.77	0.80	0.68	0.72	0.59	0.63	0.49	0.52	0.38	0.40	0.25	0.30			
	Max. (7)	0.95	0.96	0.89	0.91	0.84	0.86	0.77	0.81	0.71	0.76	0.64	0.70	0.57	0.63	0.49	0.55	0.40	0.46	
FWB10	Min. (1)	0.91	0.91	0.81	0.82	0.71	0.72	0.60	0.60	0.48	0.50	0.35	0.38							
	Med. (4)	0.93	0.93	0.85	0.86	0.77	0.78	0.68	0.70	0.59	0.61	0.49	0.51	0.38	0.39	0.25	0.27			
	Max. (7)	0.95	0.96	0.89	0.91	0.84	0.86	0.77	0.80	0.71	0.74	0.64	0.68	0.57	0.60	0.49	0.52	0.40	0.43	

4TW60298-1

Conditions

Cooling
Heating 2-pipe

Air: 27°C DB - 19°C WB - Water: entering 7°C - leaving 12°C
Air: 20°C Water: entering 50°C water flow as for cooling

F1 = correction factor for air flow
F2 = correction factor for capacities

Correction factors are based on an average value. This can cause deviation depending on conditions used. The Fan Coil Selection software will provide an accurate result at all conditions.



6 Correction factors

6-2 Glycol correction factors

Glycol percentage in weight	Freezing temperature (°C)	Capacity correction factor	Pressure drop correction factor
0	0	1	1.00
10	-4	0.93	1.09
20	-10	0.84	1.18
30	-16	0.76	1.27
40	-24	0.76	1.36

Glycol percentage in weight	Freezing temperature (°C)	Capacity correction factor	Pressure drop correction factor
0	0	1	1.00
10	-4	0.98	1.08
20	-10	0.97	1.11
30	-16	0.94	1.22
40	-24	0.91	1.33

4TW60298-1

Correction factors are based on an average value (at rated water flow rate). This can cause deviation depending on conditions used. The Fan Coil Selection software will provide an accurate result at all conditions.



6 Correction factors

6-3 Capacity and absorption of electric heater

6-3-1 FWV/FWL/FWM

6-3

FWV / FWL / FWM		Power input electric heater	Current Absorption
Unit	Electric heater	kW	A
FW..01	EEH01A6	1.0	4.34
FW..02	EEH02A6	1.5	6.52
FW..03	EEH03A6	1.6	6.95
FW..04	EEH06A6	2.0	8.69
FW..06	EEH06A6	2.0	8.69
FW..08	EEH10A6	3.0	13.00
FW..10	EEH10A6	3.0	13.00

4TW60011-3

6-3-2 FWD

FWD		Power input electric heater	Current Absorption
Unit	Electric heater	kW	A
FWD04	EDEHS04A6	2.0	8.7
FWD06	EDEHS06A6	3.0	4.3
	EDEHB06A6	6.0	8.7
FWD08	EDEHS10A6	4.5	6.5
	EDEHB10A6	9.0	13.0
FWD10	EDEHS10A6	4.5	6.5
	EDEHB10A6	9.0	13.0
FWD12	EDEHS12A6	4.5	6.5
	EDEHB12A6	9.0	13.0
FWD16	EDEHS18A6	9.0	13.0
	EDEHB18A6	12.0	17.3
FWD18	EDEHS18A6	9.0	13.0
	EDEHB18A6	12.0	17.3

4TW60221-3

6-3-3 FWB

FWB		Power input electric heater	Current Absorption
Unit	Electric heater	kW	A
FWB02C		2.0	8.7
FWB03C		2.0	8.7
FWB04C		2.0	8.7
FWB05C		2.5	10.9
FWB06C		2.5	10.9
FWB07C		2.5	10.9
FWB08C		3.0	13.0
FWB09C		3.0	13.0
FWB10C		3.0	13.0

4TW60298-1



7 Water pressure drop

7-1 FWV/FWL/FWM

7-1-1 2-pipe series - cooling

7

7-1

FWV / FWL / FWM							
Water flow l/h	Water pressure drop						
	FW..01	FW..02	FW..03	FW..04	FW..06	FW..08	FW..10
	kPa	kPa	kPa	kPa	kPa	kPa	kPa
50	0.71	0.41	0.19	0.11	0.1	0.05	0.05
100	2.44	1.42	0.66	0.36	0.35	0.16	0.16
200	8.25	4.81	2.25	1.23	1.21	0.56	0.55
300	16.84	9.81	4.6	2.51	2.46	1.14	1.14
400	27.92	16.27	7.63	4.17	4.09	1.9	1.89
500	41.33	24.09	11.3	6.18	6.06	2.82	2.81
600	56.93	33.19	15.57	8.51	8.35	3.89	3.87
800	94.32	55.02	25.82	14.12	13.84	6.44	6.42
1000	139.51	81.4	38.2	20.9	20.5	9.54	9.5
1500	-	165.77	77.83	42.61	41.8	19.46	19.39
2000	-	-	128.9	70.59	69.27	32.27	32.15
2500	-	-	-	104.41	102.47	47.75	47.58
3000	-	-	-	143.74	141.09	65.76	65.53
4000	-	-	-	-	-	108.92	108.56
5000	-	-	-	-	-	161.06	160.55

4TW60019-1 (Sheet 1/3)

7-1-2 2-pipe series - heating


FWV / FWL / FWM							
Water flow l/h	Water pressure drop						
	FW..01	FW..02	FW..03	FW..04	FW..06	FW..08	FW..10
	kPa	kPa	kPa	kPa	kPa	kPa	kPa
50	0.61	0.36	0.17	0.09	0.09	0.04	0.04
100	2.02	1.19	0.56	0.31	0.31	0.14	0.14
200	6.72	3.94	1.86	1.02	1.01	0.47	0.47
300	13.6	7.97	3.75	2.07	2.04	0.96	0.95
400	22.45	13.14	6.18	3.41	3.36	1.57	1.57
500	33.14	19.39	9.12	5.02	4.95	2.32	2.31
600	45.55	26.64	12.53	6.89	6.79	3.18	3.17
800	75.27	44.01	20.69	11.38	11.2	5.24	5.23
1000	111.15	64.97	30.54	16.79	16.52	7.72	7.71
1500	-	-	62.01	34.06	33.49	15.64	15.61
2000	-	-	102.52	56.28	55.34	25.84	25.78
2500	-	-	-	83.12	81.71	38.15	38.05
3000	-	-	-	-	112.36	52.45	52.32
4000	-	-	-	-	-	86.7	86.47
5000	-	-	-	-	-	-	127.7

4TW60019-1 (Sheet 2/3)

7-1-3 4-pipe series - heating

FWV / FWL / FWM							
Water flow l/h	Water pressure drop						
	FW..01	FW..02	FW..03	FW..04	FW..06	FW..08	FW..10
	kPa	kPa	kPa	kPa	kPa	kPa	kPa
50	0.68	0.68	0.26	0.23	0.21	0.28	0.28
100	2.27	2.27	0.87	0.78	0.7	0.93	0.94
200	7.55	7.55	2.88	2.58	2.32	3.07	3.12
300	15.3	15.3	5.83	5.21	4.69	6.18	6.29
400	25.26	25.26	9.62	8.59	7.73	10.16	10.34
500	37.28	37.28	14.19	12.67	11.4	14.97	15.23
600	51.25	51.25	19.5	17.41	15.65	20.54	20.9
800	84.71	84.71	32.22	28.75	25.84	33.88	34.46
1000	-	-	47.57	42.43	38.12	49.97	50.82
1500	-	-	-	86.13	77.36	101.32	103.02

4TW60019-1 (Sheet 3/3)



7 Water pressure drop

7-2 FWD

7 7-2-1 2-pipe series - cooling

7-2

Water flow l/h	FWD						
	Water pressure drop						
	FWD04	FWD06	FWD08	FWD10	FWD12	FWD16	FWD18
	kPa	kPa	kPa	kPa	kPa	kPa	kPa
100	0.59	0.37	0.25	0.13	0.13	0.09	0.1
200	2.02	1.25	0.84	0.45	0.43	0.32	0.35
300	4.12	2.57	1.72	0.92	0.88	0.65	0.71
400	6.83	4.27	2.86	1.53	1.47	1.08	1.19
500	10.12	6.32	4.24	2.27	2.19	1.6	1.76
600	13.94	8.71	5.85	3.14	3.02	2.22	2.44
700	18.28	11.42	7.67	4.12	3.97	2.92	3.2
800	23.12	14.45	9.69	5.21	5.02	3.69	4.06
900	28.45	17.77	11.92	6.41	6.17	4.55	5
1000	34.23	21.39	14.35	7.71	7.43	5.48	6.02
1100	40.48	25.29	16.97	9.11	8.79	6.47	7.11
1200	47.17	29.48	19.78	10.62	10.24	7.54	8.29
1300	54.29	33.94	22.77	12.23	11.78	8.68	9.54
1400	61.84	38.66	25.94	13.93	13.42	9.89	10.87
1500	69.81	43.65	29.28	15.73	15.16	11.16	12.27
1600	78.19	48.9	32.8	17.62	16.98	12.5	13.75
1700	86.97	54.4	36.5	19.6	18.89	13.91	15.3
1800	96.15	60.15	40.36	21.67	20.89	15.38	16.92
1900	105.73	66.15	44.38	23.83	22.97	16.92	18.61
2000	-	72.39	48.57	26.08	25.14	18.52	20.37
2100	-	78.88	52.93	28.42	27.4	20.18	22.19
2200	-	85.6	57.44	30.84	29.73	21.9	24.09
2300	-	92.55	62.11	33.35	32.15	23.68	26.05
2400	-	99.74	66.93	35.94	34.65	25.53	28.08
2500	-	107.16	71.91	38.62	37.23	27.43	30.17
3000	-	-	99.07	53.21	51.3	37.8	41.59
4000	-	-	-	88.2	85.07	62.71	69
5000	-	-	-	-	-	92.83	102.16

4TW60229-1 (Sheet 1/3)


7-2-2 2-pipe series - heating

Water flow l/h	FWD						
	Water pressure drop						
	FWD04	FWD06	FWD08	FWD10	FWD12	FWD16	FWD18
	kPa	kPa	kPa	kPa	kPa	kPa	kPa
100	0.51	0.32	0.22	0.12	0.11	0.08	0.09
200	1.68	1.07	0.72	0.39	0.38	0.28	0.31
300	3.4	2.16	1.46	0.78	0.76	0.56	0.62
400	5.6	3.56	2.4	1.29	1.25	0.93	1.03
500	8.25	5.24	3.53	1.9	1.84	1.37	1.51
600	11.33	7.18	4.84	2.61	2.53	1.88	2.07
700	14.81	9.39	6.32	3.4	3.3	2.45	2.71
800	18.69	11.83	7.97	4.29	4.16	3.09	3.41
900	22.95	14.52	9.77	5.26	5.1	3.79	4.18
1000	27.57	17.43	11.73	6.32	6.12	4.55	5.02
1100	32.55	20.57	13.85	7.46	7.22	5.36	5.91
1200	37.89	23.94	16.11	8.67	8.4	6.23	6.88
1300	43.56	27.51	18.51	9.97	9.65	7.14	7.9
1400	49.58	31.3	21.06	11.34	10.97	8.14	8.98
1500	55.92	35.29	23.74	12.78	12.37	9.17	10.12
1600	62.58	39.49	26.57	14.3	13.84	10.26	11.32
1700	69.57	43.89	29.52	15.89	15.37	11.4	12.57
1800	76.87	48.49	32.61	17.55	16.98	12.59	13.88
1900	84.48	53.28	35.83	19.28	18.65	13.83	15.24
2000	92.4	58.26	39.18	21.09	20.39	15.12	16.66
2100	100.61	63.43	42.66	22.95	22.2	16.45	18.14
2200	109.13	68.79	46.26	24.89	24.07	17.84	19.66
2300	-	74.34	49.99	26.9	26.01	19.27	21.24
2400	-	80.07	53.84	28.97	28.01	20.75	22.87
2500	-	85.97	57.81	31.1	30.08	22.28	24.55
3000	-	118.18	79.46	42.74	41.32	30.59	33.71
4000	-	-	-	70.61	68.24	50.5	55.63
5000	-	-	-	104.24	100.72	74.51	82.08

4TW60229-1 (Sheet 2/3)

7 Water pressure drop

7-2 FWD



7-2-3 4-pipe series - heating

7
7-2

FWD							
Water flow l/h	Water pressure drop						
	FWD04	FWD06	FWD08	FWD10	FWD12	FWD16	FWD18
	kPa	kPa	kPa	kPa	kPa	kPa	kPa
100	0.83	0.71	0.35	0.35	0.13	0.1	0.1
200	2.75	2.36	1.16	1.16	0.42	0.33	0.33
300	5.55	4.76	2.34	2.34	0.85	0.67	0.67
400	9.14	7.84	3.84	3.84	1.39	1.1	1.1
500	13.48	11.54	5.65	5.65	2.05	1.61	1.61
600	18.51	15.83	7.75	7.75	2.81	2.21	2.21
700	24.21	20.7	10.13	10.13	3.66	2.88	2.88
800	30.56	26.1	12.77	12.77	4.62	3.63	3.63
900	37.52	32.04	15.68	15.68	5.66	4.45	4.45
1000	45.09	38.49	18.83	18.83	6.8	5.34	5.34
1100	53.25	45.44	22.22	22.22	8.02	6.29	6.29
1200	61.98	52.88	25.85	25.85	9.33	7.32	7.32
1300	71.27	60.8	29.72	29.72	10.72	8.41	8.41
1400	81.11	69.18	33.81	33.81	12.19	9.56	9.56
1500	91.5	78.03	38.13	38.13	13.74	10.78	10.78
1600	102.41	87.32	42.67	42.67	15.37	12.06	12.06
1700	-	97.06	47.42	47.42	17.08	13.39	13.39
1800	-	107.24	52.39	52.39	18.87	14.79	14.79
1900	-	-	57.57	57.57	20.73	16.25	16.25
2000	-	-	62.96	62.96	22.67	17.76	17.76
2500	-	-	92.92	92.92	33.44	26.19	26.19
3000	-	-	-	-	45.95	35.98	35.98
3500	-	-	-	-	60.12	47.06	47.06
4000	-	-	-	-	75.89	59.4	59.4
4500	-	-	-	-	93.21	72.95	72.95
5000	-	-	-	-	112.04	87.67	87.67

4TW60229-1 (Sheet 3/3)

7 Water pressure drop

7-3 FWB



7 7-3-1 2-pipe series - cooling

7-3

FWB									
Water flow l/h	Water pressure drop								
	FWB02	FWB03	FWB04	FWB05	FWB06	FWB07	FWB08	FWB09	FWB10
	kPa	kPa	kPa	kPa	kPa	kPa	kPa	kPa	kPa
100	1	1	<1	<1	<1	<1	<1	<1	<1
200	2	2	2	1	<1	1	1	1	1
300	4	5	3	2	1	1	2	1	1
400	6	8	5	4	2	2	3	2	2
500	9	12	8	6	3	4	4	3	3
600	13	16	11	8	3	5	5	4	4
700	17	21	14	10	5	6	7	5	5
800	21	27	18	13	6	8	9	7	6
900	26	33	22	16	7	10	11	8	8
1000	32	40	27	19	9	12	13	10	10
1100	37	47	32	23	10	14	15	12	11
1200	44	55	37	26	12	16	18	14	13
1300	50	64	42	30	14	19	20	16	15
1400	57	72	48	35	15	21	23	18	17
1500	65	82	55	39	17	24	26	21	20
1600	72	92	61	44	20	27	29	23	22
1700	81	102	68	49	22	30	33	26	24
1800	89		75	54	24	33	36	29	27
1900	98		83	59	26	37	40	32	30
2000	107		91	65	29	40	44	34	32
2100			99	71	32	44	48	38	35
2200			107	77	34	48	52	41	38
2300				83	37	51	56	44	41
2400				89	40	55	60	48	45
2500				96	43	60	65	51	48
3000					59	82	89	70	66
3500					77	108	117	92	87
4000					98			117	110

4TW60299-1 (Sheet 1/3)

7 Water pressure drop

7-3 FWB



7-3-2 2-pipe series - heating

7

7-3

FWB									
Water flow l/h	Water pressure drop								
	FWB02	FWB03	FWB04	FWB05	FWB06	FWB07	FWB08	FWB09	FWB10
	kPa	kPa	kPa	kPa	kPa	kPa	kPa	kPa	kPa
100	<1	1	<1	<1	<1	<1	<1	<1	<1
200	2	2	1	1	<1	1	1	1	<1
300	3	4	3	2	1	1	1	1	1
400	5	7	4	3	1	2	2	2	2
500	8	10	7	5	2	3	3	3	2
600	11	13	9	6	3	4	4	3	3
700	14	17	12	8	4	5	6	5	4
800	17	22	15	11	5	7	7	6	5
900	21	27	18	13	6	8	9	7	7
1000	26	32	22	16	7	10	11	8	8
1100	30	38	26	18	8	12	13	10	9
1200	35	45	30	21	10	13	15	12	11
1300	40	51	34	25	11	15	17	13	13
1400	46	58	39	28	13	17	19	15	14
1500	52	66	44	32	14	20	22	17	16
1600	58	74	49	35	16	22	24	19	18
1700	65	82	55	39	18	25	27	21	20
1800	71	90	60	43	19	27	30	23	22
1900	78	99	66	48	21	30	32	26	24
2000	86	109	73	52	23	33	35	28	27
2100	93		79	57	25	35	39	31	29
2200	101		86	62	28	38	42	33	31
2300	110		93	67	30	41	45	36	34
2400			100	72	32	45	49	39	36
2500			107	77	35	48	52	41	39
3000				106	47	66	72	57	54
3500					62	86	94	74	70
4000					78	109	119	94	89
4500					96			115	109
5000					116				

4TW60299-1 (Sheet 2/3)

7 Water pressure drop

7-3 FWB



7-3-3 Additional heat exchanger

7-3

Water flow l/h	FWB		
	Water pressure drop		
	EAH04A6	EAH07A6	EAH10A6
	kPa	kPa	kPa
100	1	<1	<1
200	2	1	<1
300	4	2	1
400	7	3	1
500	10	5	2
600	13	7	3
700	17	9	3
800	22	11	4
900	27	13	5
1000	32	16	6
1100	38	19	8
1200	44	22	9
1300	51	25	10
1400	58	29	11
1500	66	32	13
1600	73	36	14
1700	82	40	16
1800	90	44	18
1900	99	49	19
2000	108	53	21
2100	118	58	23
2200		63	25
2300		68	27
2400		73	29
2500		79	31
3000		108	43
3500			56
4000			71
4500			87
5000			105

4TW60299-1 (Sheet 3/3)



8 Operation range

8-1 FWV/FWL/FWM

Minimum water temperature	+5°C
Maximum water temperature	+95°C
Maximum operating pressure	10 bar
Minimum air inlet temperature	5°C
Maximum air inlet temperature	+43°C
Power supply	230V +-10% / 1~ / 50Hz

4TW60013-1

8

8-1

8-2 FWD

Minimum water temperature	+5°C
Maximum water temperature	+95°C
Maximum operating pressure	10 bar
Minimum air inlet temperature	-20°C
Maximum air inlet temperature	+43°C
Power supply	230V +-10% / 1~ / 50Hz

4TW60223-1

8-3 FWB

Minimum water temperature	+5°C
Maximum water temperature	+95°C
Maximum operating pressure	10 bar
Minimum air inlet temperature	5°C
Maximum air inlet temperature	+43°C
Power supply	230V +-10% / 1~ / 50Hz

4TW60293-1




9 Dimensional drawings


9-1 FWV/FWL

9
9-1

FWV

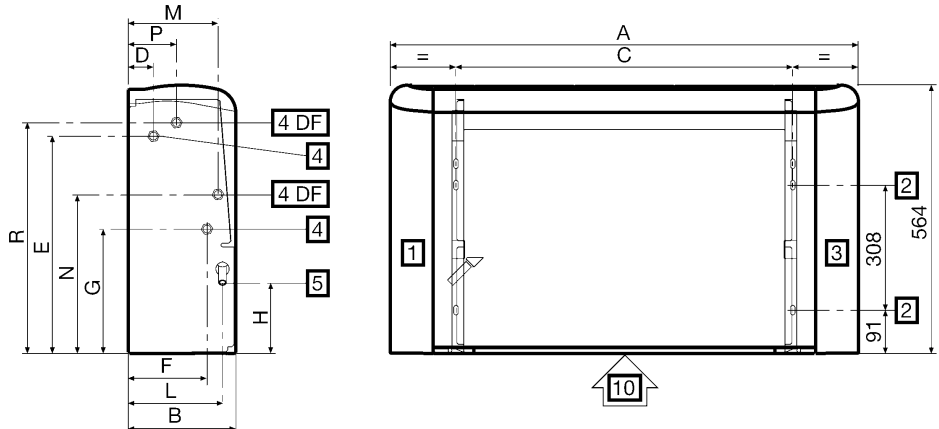

FWL

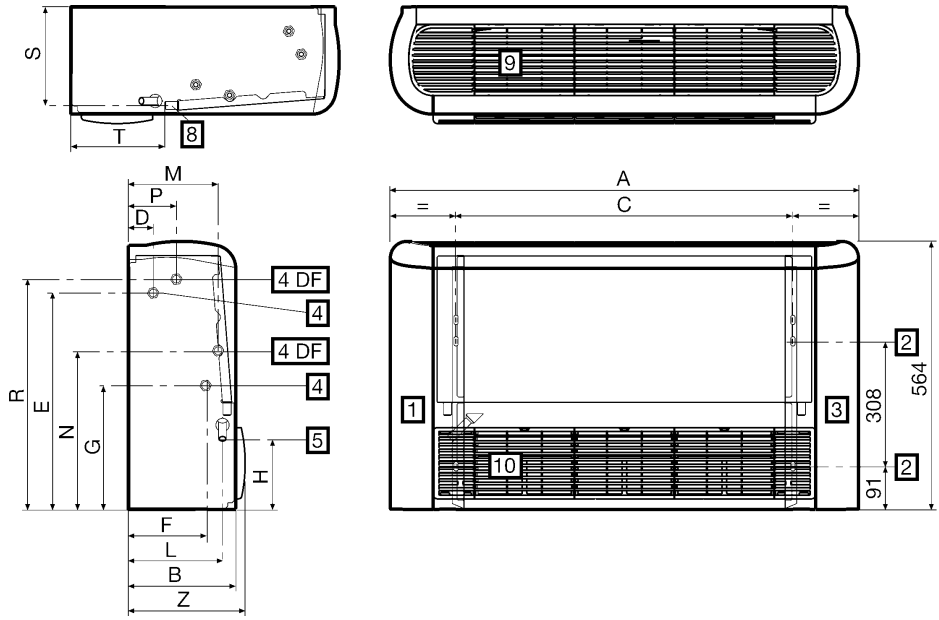

	A	B	C	D	E	F	G	H	L	M	N	P	R	S	T	Z
FWV+FWL 01+02	774	226	498	51	458	163	263	149	198	187	335	99	486	208	198	246
FWV+FWL 03	984	226	708	51	458	163	263	149	198	187	335	99	486	208	198	246
FWV+FWL 04+06	1194	226	918	51	458	163	263	149	198	187	335	99	486	208	198	246
FWV+FWL 08+10	1404	251	1128	48	497	185	259	155	220	195	348	120	478	234	208	271




9 Dimensional drawings

9-2 FWM

9
9-2

FWM

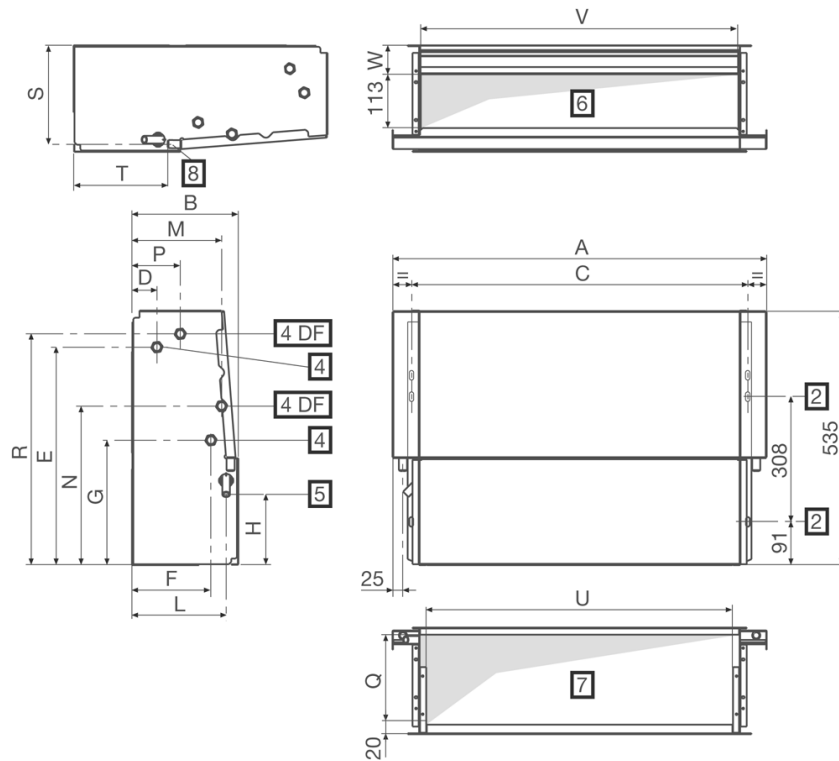

	A	B	C	D	E	F	G	H	L	M	N	P	Q	R	S	T	U	V	W
FWM 01+02	584	224	498	51	458	163	263	149	198	187	335	99	189	486	208	198	436	464	61
FWM 03	794	224	708	51	458	163	263	149	198	187	335	99	189	486	208	198	646	674	61
FWM 04+06	1004	224	918	51	458	163	263	149	198	187	335	99	189	486	208	198	856	884	61
FWM 08+10	1214	249	1128	48	497	185	259	155	220	195	348	120	215	478	234	208	1066	1094	67

4TW60014-1 (Sheet 2/2)




9 Dimensional drawings

9-3 FWD

9

9-3


FWD04~10

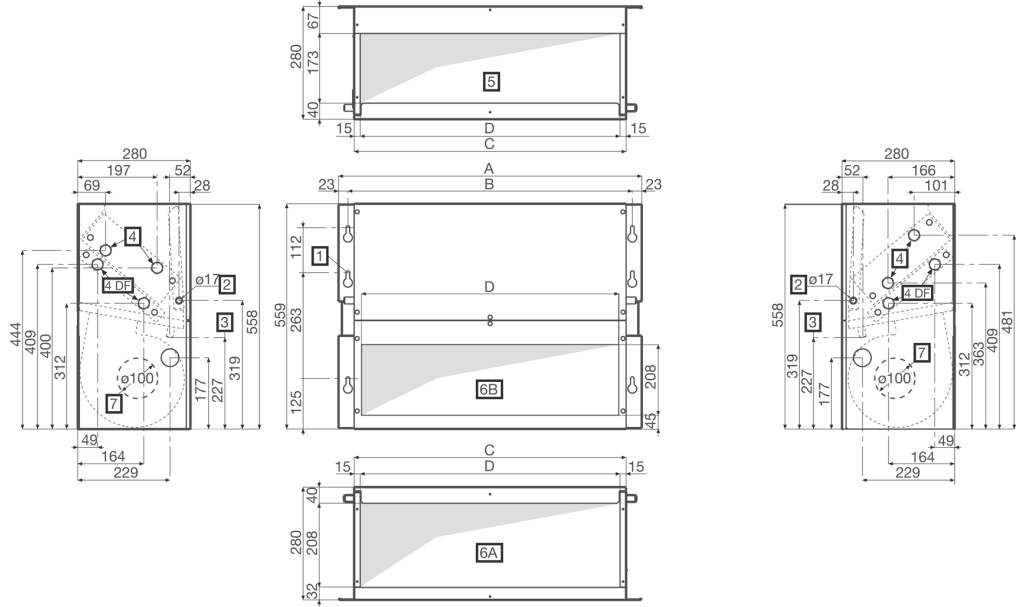

	A	B	C	D
FWD04	754	707	676	646
FWD06	964	917	886	856
FWD08+10	1174	1127	1096	1066

4TW60224-1 (Sheet 1/2)

FWD12~18

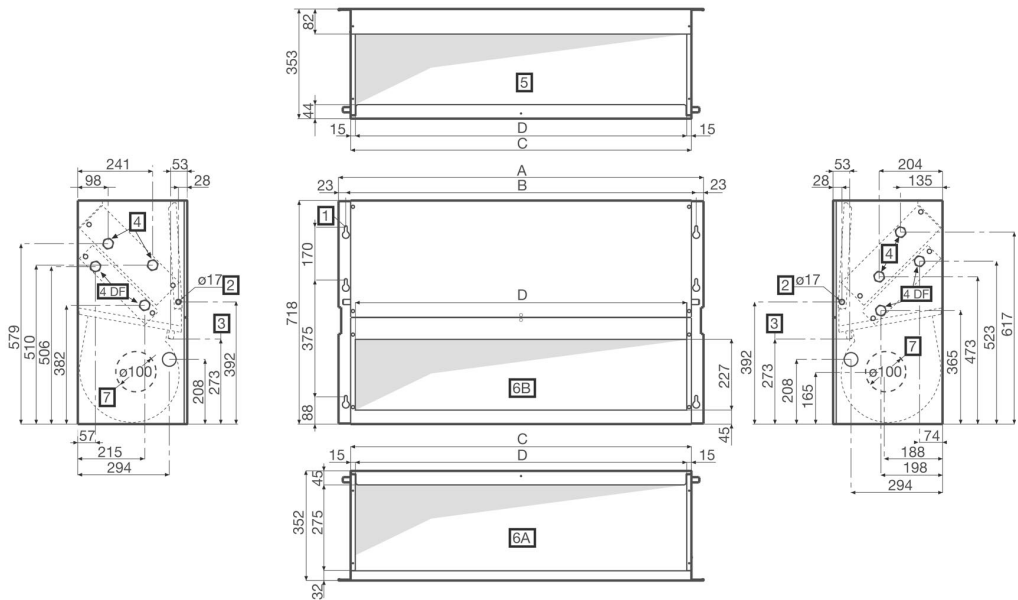

	A	B	C	D
FWD12	1174	1127	1096	1066
FWD16+18	1384	1337	1306	1276

4TW60224-1 (Sheet 2/2)




9 Dimensional drawings

9-4 FWB

9

9-4

FWB

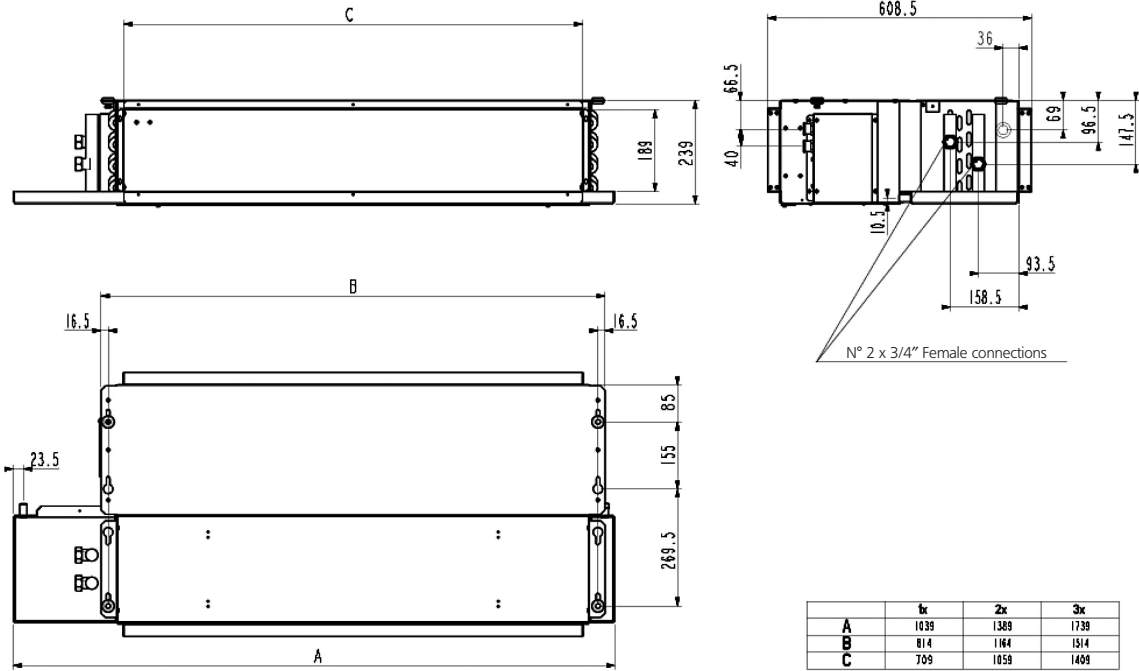


4TW60294-1



10 Wiring diagrams

10-1 FWV/FWL/FWM

10
10-1

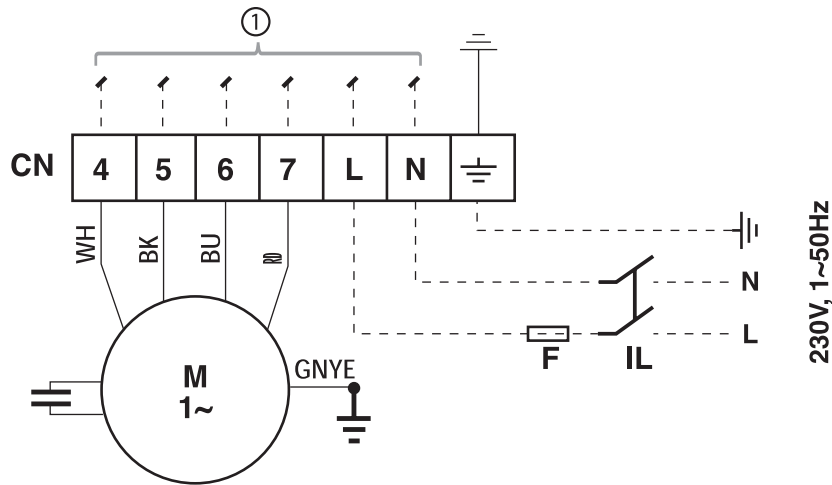

SYMBOLS

- BK Black = maximum speed
- BU Blue = medium speed
- GNYE Yellow/Green = earth connection
- RD Red = minimum speed
- WH White = common
- Field wiring
- F Protection fuse (field supply)
- IL Main switch (field supply)
- M Fan motor
- PE Earth connection

4TW60016-1




10 Wiring diagrams

10-2 FWD

10

10-2

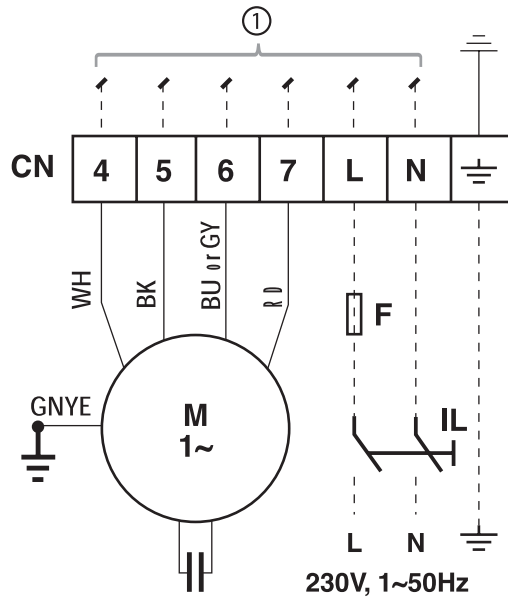

SYMBOLS

- BK Black = maximum speed
- BU Blue = medium speed
- GNYE Yellow/Green = earth connection
- RD Red = minimum speed
- WH White = common
- Field wiring
- F Protection fuse (field supply)
- IL Main switch (field supply)
- M Fan motor
- PE Earth connection


4TW60226-1



10 Wiring diagrams

10-3 FWB


10
10-3

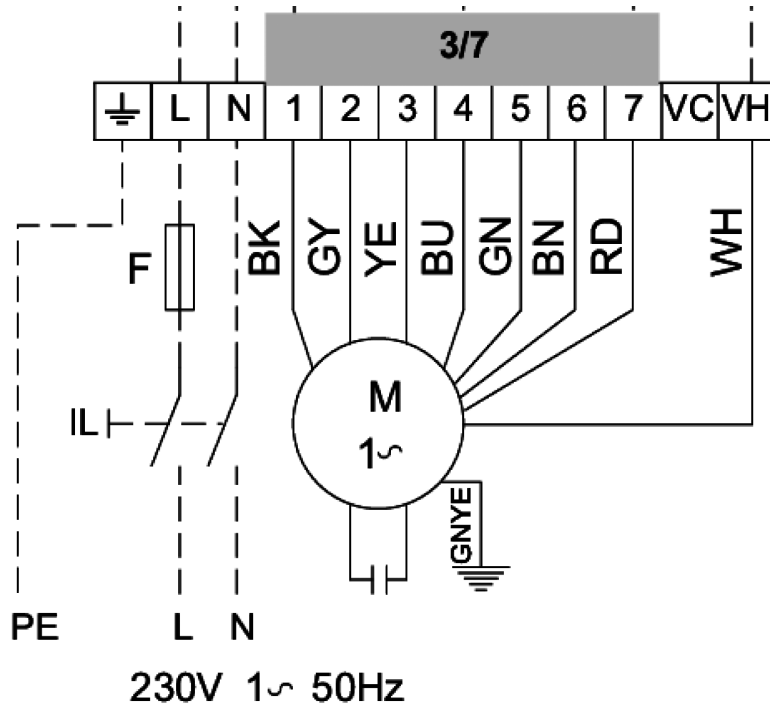

SYMBOLS

- BK Black = maximum speed
- BU Blue = medium speed
- GNYE Yellow/Green = earth connection
- RD Red = minimum speed
- WH White = common
- Field wiring
- F Protection fuse (field supply)
- IL Main switch (field supply)
- M Fan motor
- PE Earth connection

4TW60296-1



11 Sound power data

11-1 FWV/FWL/FWM

11-1-1 2-pipe series

11
11-1

Sound power level								
FW..01 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	27.2	42.0	43.1	41.1	37.1	27.6	17.6	47
Med.	20.7	34.2	35.2	33.0	27.2	18.2	16.5	39
Min.	18.6	29.6	30.6	26.5	20.7	15.9	16.0	34
FW..02 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	30.2	44.5	47.8	46.8	43.1	34.6	22.2	52
Med.	24.1	38.4	40.4	38.4	33.4	24.5	16.2	44
Min.	17.8	31.9	31.8	28.6	22.0	17.2	15.1	36
FW..03 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	31.4	42.6	46.0	44.5	42.6	34.8	21.7	50
Med.	26.5	36.6	40.4	37.2	33.7	24.8	17.8	44
Min.	22.9	33.2	35.3	29.1	24.5	18.8	17.4	38
FW..04 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	35.5	48.3	51.1	49.4	46.3	36.5	22.6	55
Med.	29.0	41.7	43.8	41.2	36.6	25.4	16.9	48
Min.	23.6	35.8	36.4	32.0	25.3	18.2	16.0	40
FW..06 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	39.1	51.8	54.5	54.3	50.3	42.5	31.1	59
Med.	34.1	45.1	47.0	46.0	41.7	32.2	19.6	52
Min.	29.6	38.3	39.8	37.3	32.0	22.0	14.7	44
FW..08 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	40.0	54.2	55.8	54.7	52.8	46.4	35.2	61
Med.	33.6	47.9	49.2	47.7	45.0	36.3	23.9	54
Min.	27.7	41.7	42.1	40.3	35.5	25.8	21.1	47
FW..10 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	44.5	58.0	60.1	60.4	58.4	53.6	46.3	66
Med.	37.5	50.7	53.8	52.5	50.5	44.3	33.7	58
Min.	27.8	42.2	43.8	41.6	38.1	28.6	20.9	48
Conditions of measurements	in case of (M) models the sound power is calculated WITHOUT any additional inlet or outlet grill or plenum!							

4TW60017-1 (Sheet 1/2)

To calculate the sound pressure you must define some conditions and use this formula

$$L_p = L_w - 10 \times \log_{10} \left(\frac{4\pi \times d^2}{Q} \right)$$

Where:

Q = direction factor: is Q=4 if the FCU is installed near 2 walls (vertical or floor-ceiling), Q=2 if the FCU is installed near 1 wall (at floor or ceiling but faraway the 2nd wall)

d = distance (mt) from the sound source and the measure point

LP = Sound pressure (dBA)

Lw = Sound power (dBA)



11 Sound power data

11-1 FWV/FWL/FWM

11 11-1-2 4-pipe series

11-1

Sound power level								
FW..01 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	27.2	42.0	43.1	41.1	37.1	27.6	17.6	47
Med.	20.7	34.2	35.2	33.0	27.2	18.2	16.5	39
Min.	18.6	29.6	30.6	26.5	20.7	15.9	16.0	34
FW..02 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	32.2	46.5	49.8	48.8	45.1	36.6	24.2	54
Med.	28.1	42.4	44.4	42.4	37.4	28.5	20.2	48
Min.	23.8	37.9	37.8	34.6	28.0	23.2	21.1	42
FW..03 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	31.4	42.6	46.0	44.5	42.6	34.8	21.7	50
Med.	26.5	36.6	40.4	37.2	33.7	24.8	17.8	44
Min.	22.9	33.2	35.3	29.1	24.5	18.8	17.4	38
FW..04 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	35.5	48.3	51.1	49.4	46.3	36.5	22.6	55
Med.	29.0	41.7	43.8	41.2	36.6	25.4	16.9	48
Min.	23.6	35.8	36.4	32.0	25.3	18.2	16.0	40
FW06 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	39.1	51.8	54.5	54.3	50.3	42.5	31.1	59
Med.	35.1	46.1	48.0	47.0	42.7	33.2	20.6	53
Min.	31.6	40.3	41.8	39.3	34.0	24.0	16.7	46
FW08 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	38.0	52.2	53.8	52.7	50.8	44.4	33.2	59
Med.	31.6	45.9	47.2	45.7	43.0	34.3	21.9	52
Min.	24.7	38.7	39.1	37.3	32.5	22.8	18.1	44
FW10 TN/TV								
Sound Power Levels dB(A)	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	44.5	58.0	60.1	60.4	58.4	53.6	46.3	66
Med.	37.5	50.7	53.8	52.5	50.5	44.3	33.7	58
Min.	27.8	42.2	43.8	41.6	38.1	28.6	20.9	48
Conditions of measurements	in case of (M) models the sound power is calculated WITHOUT any additional inlet or outlet grill or plenum!							

4TW60017-1 (Sheet 2/2)

To calculate the sound pressure you must define some conditions and use this formula

$$L_p = L_w - 10 \times \log_{10} \left(\frac{4\pi \times d^2}{Q} \right)$$

Where:

Q = direction factor: is Q=4 if the FCU is installed near 2 walls (vertical or floor-ceiling), Q=2 if the FCU is installed near 1 wall (at floor or ceiling but faraway the 2nd wall)

d = distance (mt) from the sound source and the measure point

LP = Sound pressure (dBA)

Lw = Sound power (dBA)



11 Sound power data

11-2 FWD

11-2-1 2-pipe/4-pipe series

11
11-2

FWD04		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	Lw tot dB(A)	43.6	47.0	60.0	62.0	60.7	54.8	46.2	66
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	40.4	43.3	55.9	58.4	57.0	51.4	42.9	62.5
	Structure	29.3	38.5	53.6	53.0	52.1	43.8	34.3	58.0
	Inlet	40.4	43.3	55.9	58.4	57.0	51.4	42.9	62.5
Med.	Lw tot dB(A)	40.7	53.8	53.8	57.0	53.6	50.6	43.3	61
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	37.5	50.2	49.7	53.4	49.9	47.2	40.0	57.7
	Structure	26.4	45.3	47.4	47.9	45.0	39.6	31.5	52.9
	Inlet	37.5	50.2	49.7	53.4	49.9	47.2	40.0	57.7
Min.	Lw tot dB(A)	33.8	47.7	47.0	49.8	47.0	41.9	33.5	54
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	30.6	44.1	42.9	46.2	43.3	38.6	30.2	50.7
	Structure	19.5	39.2	40.6	40.8	38.4	30.9	21.6	46.0
	Inlet	30.6	44.1	42.9	46.2	43.3	38.6	30.2	50.7


4TW60227-1 (Sheet 1/7)

Sound power levels measured at ESP = 0 Pa

FWD06		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	Lw tot dB(A)	45.0	56.9	60.8	64.7	63.5	57.7	49.7	69
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	41.8	53.2	56.7	61.2	59.9	54.4	46.4	65.2
	Structure	30.7	48.3	54.4	55.7	55.0	46.7	37.8	60.3
	Inlet	41.8	53.2	56.7	61.2	59.9	54.4	46.4	65.2
Med.	Lw tot dB(A)	41.5	52.6	56.9	59.0	54.7	50.9	40.5	63
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	38.3	49.0	52.7	55.4	51.1	47.6	37.2	59.1
	Structure	27.2	44.1	50.4	50.0	46.2	39.9	28.7	54.6
	Inlet	38.3	49.0	52.7	55.4	51.1	47.6	37.2	59.1
Min.	Outlet	33.9	45.1	48.8	50.8	46.3	45.3	30.2	54.9
	Structure	22.8	40.3	46.5	45.3	41.4	37.6	21.6	50.4
	Inlet	33.9	45.1	48.8	50.8	46.3	45.3	30.2	54.9

4TW60227-1 (Sheet 2/7)

Sound power levels measured at ESP = 0 Pa



11 Sound power data

11-2 FWD

11

11-2-1 2-pipe/4-pipe series

11-2

FWD08		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	Lw tot dB(A)	50.7	62.1	64.8	68.1	66.5	62.5	56.2	72
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	47.5	58.4	60.7	64.5	62.8	59.1	52.9	68.9
	Structure	36.4	53.6	58.4	59.1	57.9	51.5	44.3	64.0
	Inlet	47.5	58.4	60.7	64.5	62.8	59.1	52.9	68.9
Med.	Lw tot dB(A)	45.0	57.5	60.1	62.5	58.9	56.4	49.2	67
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	41.8	53.8	56.0	58.9	55.3	53.0	45.9	63.0
	Structure	30.7	49.0	53.7	53.5	50.4	45.4	37.3	58.4
	Inlet	41.8	53.8	56.0	58.9	55.3	53.0	45.9	63.0
Min.	Lw tot dB(A)	40.5	53.4	55.9	57.5	54.3	50.3	42.4	62
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	37.4	49.7	51.8	53.9	50.6	46.9	39.1	58.2
	Structure	26.3	44.9	49.5	48.4	45.7	39.3	30.5	53.7
	Inlet	37.4	49.7	51.8	53.9	50.6	46.9	39.1	58.2


4TW60227-1 (Sheet 3/7)

Sound power levels measured at ESP = 0 Pa

FWD10		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	Lw tot dB(A)	50.7	62.1	64.8	68.1	66.5	62.5	56.2	72
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	47.5	58.4	60.7	64.5	62.8	59.1	52.9	68.9
	Structure	36.4	53.6	58.4	59.1	57.9	51.5	44.3	64.0
	Inlet	47.5	58.4	60.7	64.5	62.8	59.1	52.9	68.9
Med.	Lw tot dB(A)	45.0	57.5	60.1	62.5	58.9	56.4	49.2	67
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	41.8	53.8	56.0	58.9	55.3	53.0	45.9	63.0
	Structure	30.7	49.0	53.7	53.5	50.4	45.4	37.3	58.4
	Inlet	41.8	53.8	56.0	58.9	55.3	53.0	45.9	63.0
Min.	Lw tot dB(A)	40.5	53.4	55.9	57.5	54.3	50.3	42.4	62
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	37.4	49.7	51.8	53.9	50.6	46.9	39.1	58.2
	Structure	26.3	44.9	49.5	48.4	45.7	39.3	30.5	53.7
	Inlet	37.4	49.7	51.8	53.9	50.6	46.9	39.1	58.2

4TW60227-1 (Sheet 4/7)

Sound power levels measured at ESP = 0 Pa



11 Sound power data

11-2 FWD

11-2-1 2-pipe/4-pipe series

11
11-2

FWD12		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	Lw tot dB(A)	52.0	62.5	65.2	70.0	69.2	64.5	58.2	74
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	48.8	58.8	61.1	66.4	65.5	61.1	54.9	70.7
	Structure	37.7	54.0	58.8	61.0	60.6	53.5	46.3	65.7
	Inlet	48.8	58.8	61.1	66.4	65.5	61.1	54.9	70.7
Med.	Lw tot dB(A)	46.2	57.7	59.9	62.8	60.5	57.1	50.0	67
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	43.1	54.0	55.8	59.2	56.9	53.8	46.8	63.5
	Structure	32.0	49.2	53.5	53.8	52.0	46.1	38.2	58.8
	Inlet	43.1	54.0	55.8	59.2	56.9	53.8	46.8	63.5
Min.	Lw tot dB(A)	39.3	50.6	54.2	55.9	53.1	47.8	41.5	60
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	36.1	46.9	50.1	52.4	49.5	44.4	38.2	56.5
	Structure	25.0	42.1	47.8	46.9	44.6	36.8	29.6	52.0
	Inlet	36.1	46.9	50.1	52.4	49.5	44.4	38.2	56.5

4TW60227-1 (Sheet 5/7)

Sound power levels measured at ESP = 0 Pa

FWD16		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	Lw tot dB(A)	61.0	70.5	70.0	72.5	71.1	69.6	63.8	78
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	57.8	66.8	65.9	68.9	67.4	66.2	60.5	74.5
	Structure	46.7	62.0	63.6	63.5	62.5	58.6	51.9	69.4
	Inlet	57.8	66.8	65.9	68.9	67.4	66.2	60.5	74.5
Med.	Lw tot dB(A)	58.3	65.1	67.1	67.9	65.8	64.2	56.7	73
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	55.2	61.4	63.0	64.3	62.1	60.8	53.4	69.8
	Structure	44.1	56.5	60.7	58.9	57.2	53.2	44.8	65.0
	Inlet	55.2	61.4	63.0	64.3	62.1	60.8	53.4	69.8
Min.	Lw tot dB(A)	52.1	61.3	62.3	63.8	62.6	60.7	49.1	69
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	48.9	57.7	58.2	60.3	58.9	57.4	45.8	65.7
	Structure	37.8	52.8	55.9	54.8	54.0	49.7	37.2	60.9
	Inlet	48.9	57.7	58.2	60.3	58.9	57.4	45.8	65.7

4TW60227-1 (Sheet 6/7)

Sound power levels measured at ESP = 0 Pa



11 Sound power data

11-2 FWD


11-2-1 2-pipe/4-pipe series

11-2

FWD018		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	Global Lw
Max.	Lw tot dB(A)	61.0	70.5	70.0	72.5	71.1	69.6	63.8	78
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	57.8	66.8	65.9	68.9	67.4	66.2	60.5	74.5
	Structure	46.7	62.0	63.6	63.5	62.5	58.6	51.9	69.4
	Inlet	57.8	66.8	65.9	68.9	67.4	66.2	60.5	74.5
Med.	Lw tot dB(A)	58.3	65.1	67.1	67.9	65.8	64.2	56.7	73
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	55.2	61.4	63.0	64.3	62.1	60.8	53.4	69.8
	Structure	44.1	56.5	60.7	58.9	57.2	53.2	44.8	65.0
	Inlet	55.2	61.4	63.0	64.3	62.1	60.8	53.4	69.8
Min.	Lw tot dB(A)	52.1	61.3	62.3	63.8	62.6	60.7	49.1	69
		125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz	
	Outlet	48.9	57.7	58.2	60.3	58.9	57.4	45.8	65.7
	Structure	37.8	52.8	55.9	54.8	54.0	49.7	37.2	60.9
	Inlet	48.9	57.7	58.2	60.3	58.9	57.4	45.8	65.7

4TW60227-1 (Sheet 7/7)

Sound power levels measured at ESP = 0 Pa



11 Sound power data

11-3 FWB

11-3-1 2-pipe series

FWB02-04		125	250	500	1000	2000	4000	8000	Global
	Speed	dB	dB	dB	dB	dB	dB	dB	dB/A
Global	7	54	57	55	53	51	45	36	58
Inlet		52	54	51	49	45	40	32	-
Outlet		50	54	52	50	48	43	33	-
Structure		37	40	47	36	43	27	19	-
Global	6	50	53	51	48	46	36	25	52
Inlet		48	50	47	44	41	31	21	-
Outlet		46	50	48	46	44	34	23	-
Structure		33	35	42	31	38	18	8	-
Global	5	47	50	48	44	42	34	23	50
Inlet		45	46	43	41	37	29	19	-
Outlet		43	47	44	42	40	32	21	-
Structure		30	32	39	27	34	16	6	-
Global	4	44	46	44	41	37	27	20	46
Inlet		41	43	40	37	32	23	16	-
Outlet		39	43	40	38	35	25	17	-
Structure		27	28	35	24	29	10	3	-
Global	3	41	44	41	38	34	23	19	43
Inlet		39	40	37	34	28	18	15	-
Outlet		37	41	38	35	31	21	16	-
Structure		24	26	32	21	25	5	2	-
Global	2	39	41	38	35	30	17	18	40
Inlet		37	38	34	31	24	13	14	-
Outlet		35	38	35	32	27	15	15	-
Structure		22	23	30	18	22	nm	nm	-
Global	1	35	38	34	31	26	15	17	36
Inlet		33	34	30	27	20	10	14	-
Outlet		31	35	31	28	23	13	15	-
Structure		18	20	26	14	17	nm	nm	-

4TW60297-1 (Sheet 1/3)

To calculate the sound pressure you must define some conditions and use this formula

$$L_p = L_w - 10 \times \log_{10} \left(\frac{4\pi \times d^2}{Q} \right)$$

Where:

Q = direction factor: is Q=4 if the FCU is installed near 2 walls (vertical or floor-ceiling), Q=2 if the FCU is installed near 1 wall (at floor or ceiling but faraway the 2nd wall)

d = distance (mt) from the sound source and the measure point

LP = Sound pressure (dBA)

Lw = Sound power (dBA)

Conditions of measurements

ISO3741 = The sound power is calculated WITHOUT any additional inlet or outlet grill or plenum.

nm = Not measurable



11 Sound power data

11-3 FWB

11-3-1 2-pipe series

11-3

FWB05-07		125	250	500	1000	2000	4000	8000	Global
	Speed	dB	dB	dB	dB	dB	dB	dB	dB/A
Global	7	55	59	59	54	52	46	37	60
Inlet		53	56	55	50	46	42	33	-
Outlet		51	57	55	52	49	44	34	-
Structure		38	42	50	37	43	28	20	-
Global	6	52	56	55	50	47	39	29	56
Inlet		50	52	51	46	41	35	25	-
Outlet		48	53	52	47	44	37	27	-
Structure		35	38	46	33	38	22	12	-
Global	5	49	55	54	47	44	34	24	54
Inlet		46	51	50	44	38	30	20	-
Outlet		44	52	51	45	41	32	21	-
Structure		32	37	45	30	36	17	7	-
Global	4	46	52	52	45	41	32	21	52
Inlet		44	49	48	42	36	28	17	-
Outlet		42	49	49	43	39	30	18	-
Structure		29	35	43	28	33	14	4	-
Global	3	45	49	47	41	36	25	16	47
Inlet		43	46	43	37	31	21	13	-
Outlet		41	46	43	38	34	23	14	-
Structure		28	31	38	24	28	7	nm	-
Global	2	41	45	43	36	30	17	15	43
Inlet		39	42	38	32	24	12	11	-
Outlet		37	42	39	33	27	15	12	-
Structure		24	28	34	19	21	nm	nm	-
Global	1	37	41	37	30	20	11	14	37
Inlet		35	37	33	26	15	6	11	-
Outlet		33	38	34	27	18	9	12	-
Structure		20	23	29	13	12	nm	nm	-

4TW60297-1 (Sheet 2/3)

To calculate the sound pressure you must define some conditions and use this formula

$$L_p = L_w - 10 \times \log_{10} \left(\frac{4\pi \times d^2}{Q} \right)$$

Where:

Q = direction factor: is Q=4 if the FCU is installed near 2 walls (vertical or floor-ceiling), Q=2 if the FCU is installed near 1 wall (at floor or ceiling but faraway the 2nd wall)

d = distance (mt) from the sound source and the measure point

LP = Sound pressure (dBA)

Lw = Sound power (dBA)

Conditions of measurements

ISO3741 = The sound power is calculated WITHOUT any additional inlet or outlet grill or plenum.

nm = Not measurable



11 Sound power data

11-3 FWB

11-3-1 2-pipe series

FWB08-10		125	250	500	1000	2000	4000	8000	Global
	Speed	dB	dB	dB	dB	dB	dB	dB	dB/A
Global	7	63	67	65	64	61	55	49	69
Inlet		61	63	61	61	56	51	45	-
Outlet		59	64	62	62	59	53	46	-
Structure		46	49	57	47	53	38	32	-
Global	6	61	64	63	63	60	53	46	67
Inlet		59	61	59	59	54	48	42	-
Outlet		57	61	60	60	57	51	43	-
Structure		44	47	55	46	51	35	29	-
Global	5	58	60	61	60	56	49	41	64
Inlet		56	57	57	57	51	44	37	-
Outlet		54	57	58	58	54	47	39	-
Structure		41	43	52	43	48	31	24	-
Global	4	52	55	56	54	51	43	34	58
Inlet		50	51	52	50	45	39	30	-
Outlet		48	52	53	51	49	41	31	-
Structure		35	37	47	37	43	26	17	-
Global	3	50	53	54	51	50	41	31	56
Inlet		48	49	50	48	44	36	27	-
Outlet		46	50	51	49	47	39	28	-
Structure		33	35	46	34	41	23	14	-
Global	2	51	50	52	49	47	39	28	54
Inlet		49	47	48	45	42	34	25	-
Outlet		47	47	49	47	45	36	26	-
Structure		34	33	44	32	39	21	11	-
Global	1	46	49	51	48	46	38	28	53
Inlet		44	46	47	44	41	33	24	-
Outlet		42	46	47	45	44	36	25	-
Structure		29	31	42	31	38	20	11	-

4TW60297-1 (Sheet 3/3)

To calculate the sound pressure you must define some conditions and use this formula

$$L_p = L_w - 10 \times \log_{10} \left(\frac{4\pi \times d^2}{Q} \right)$$

Where:

Q = direction factor: is Q=4 if the FCU is installed near 2 walls (vertical or floor-ceiling), Q=2 if the FCU is installed near 1 wall (at floor or ceiling but faraway the 2nd wall)

d = distance (mt) from the sound source and the measure point

LP = Sound pressure (dBA)

Lw = Sound power (dBA)

Conditions of measurements

ISO3741 = The sound power is calculated WITHOUT any additional inlet or outlet grill or plenum.

nm = Not measurable



12 Installation

12-1 Controller

12
12-1

	Cool/heat changeover			Options		Basic control functions		Control features		
2-pipe	✓					✓	✓	✓	✓	
	✓			✓		✓	✓		✓	
	✓				✓	✓	✓	✓	✓	
	✓			✓	✓	✓	✓		✓	
		✓				✓	✓	✓		
		✓			✓		✓	✓		
			✓	✓	✓	✓	✓	✓	✓	✓
4-pipe	✓			✓		✓	✓		✓	
	✓					✓	✓	✓	✓	
			✓			✓	✓	✓		✓
			✓	✓		✓	✓		✓	✓



Manual cool/heat changeover.



Automatic cool/heat changeover based on water temperature.



Automatic cool/heat changeover based on air temperature.



Control of the 3-way/4pipe ON/OFF valve. The water valve shut-off once the desired temperature is reached.



The controller controls the electric heater as integration or replacement of the hot water heating system. When the operating mode selector switch is turned on "electric heater" and the electric heater is turned on, the fan runs continuously at medium sp When the operating mode selector switch is turned to "electric heater" and the electric heater is turned on, the fan runs continuously at medium speed.



The fan speed can be set at one of the 3 speeds (low, medium or maximum) by turning the operation mode selector.



The fan speed is switched automatically based on the difference between the temperature set on the thermostat and the room temperature.



Optimised comfort cooling. When the fan coil has reached the desired setpoint, the fan will operate at medium speed and at regular intervals to ensure constant room temperature and lower sound.



The controller prevents the fan coil unit from operating in one mode, if the required water temperature is not achieved to operate in the selected mode.



The dead zone is a temperature interval close to the set temperature. When the air is warmer/cooler than the top/lower limit of the neutral zone, the cooling/heating mode is selected.



12 Installation

12-2 Installation precautions

12-2-1 FWW/FWL/FWM

12
12-2

Fan coil units should be installed in a position where they heat and cool the room evenly, on walls or ceilings that can bear their weight. Fit any accessories on the standard unit before installing it. Read the relevant technical sheets for the installation and use of the accessories. Keep free space around the fan coil to allow proper operation and ordinary and extraordinary maintenance (see the "7. Dimensional drawings") Provide a panel to reach the unit in case of recessed mounting (Concealed models). Install the remote control panel, if any, in a position that can easily be reached by the user to set the functions and that is suitable for the proper detection of the temperature, if provided.

Therefore avoid:

- positions directly exposed to sunlight;
- positions exposed to hot or cold draughts;
- obstacles preventing the proper temperature detection

If the system is shut down during the winter months, drain off the water from the system to prevent damage due to freezing; if antifreeze solutions are used, check the freezing point using the table shown on technical manual.

Keep at least 100 mm of free space at air inlet for a proper air suction and an easy removal of the filter.

For ducted units the outlet/inlet grill surface must be at least equal to the outlet/inlet surface of the unit to avoid extra noise and strong performance reduction.

BEFORE THE INSTALLATION

Installation and maintenance should be carried out by technical personnel qualified for this type of machine, in compliance with current safety regulations.

For installation and use of possible accessories please refer to the pertinent technical sheets.

In choosing where to install the unit, comply with the following points:

- the heating unit should not be placed immediately under a socket
 - do not install the unit in rooms where inflammable gases are present
 - do not let water is sprayed directly on the unit
 - install the unit on ceilings or walls that bear its weight. Leave enough space all around for proper operation and maintenance of the unit.
- Keep the unit in its packaging until it is ready to be installed, to prevent dust getting inside it.

INSTALLATION WARNING:

On the fan coil install a switch (IL) and/or all remote controls in a position out of the reach of persons who are in a bathtub or shower.

In case of ceiling-mounted models, check that the installation height does not exceed the maximum height shown in 7. Dimensional drawings in order to avoid excessive hot air stratification in the upper part of the room; in case of greater installation heights we suggest to proceed with the back suction from the lower part of the room. The installation heights shown in the figure refer to the maximum running speed.

Carry out the hydraulic connections to the heat exchanger and in case of cooling operation, to the water drainage system. We suggest to provide for the water inlet from the bottom side of the heat exchanger and the outlet on the upper side. Bleed the air from the heat exchanger operating on the air-vent valves (10 hexagon wrench) located beside the water connections of the heat exchanger. For a better water drainage lean the drain pipe downwards at least 3 cm/m avoiding loops or narrowing on its way.

INSTALLATION FOR THE CONCEALED CEILING MODEL

The air outlets should not be placed immediately under a socket. For the concealed ceiling model, perform the connection between the fan coil and the ducts, and place damping material between the duct and the unit. The ducts, in particular the outlet ones, must be insulated. In order to avoid air back suction on the fan coil, keep a minimum distance between the air outlet and recovered air flow as shown in installation manual of the unit. The minimum installation height should not be lower than 1.8 metres from floor level. Provide for an inspection port to the unit.

4TW60019-3 (Sheet 1/2)



12 Installation

12-2 Installation precautions

12 12-2-1 FWW/FWL/FWM

12-2

ELECTRICAL CONNECTIONS

Carry out the electrical wiring after having turned the power off in compliance with the relevant local and national regulations following the relevant wiring diagram.

Check that the power supply corresponds to the rated power reported on the unit nameplate.

Each fan coil requires a switch (IL) on the feeder line with a distance of at least 3 mm between the opening contacts, and a suitable safety fuse (F).

USE

To use the fan coil unit, refer to the instructions of the control panel, available as accessory.

Air outlet grids on the cover cabinet (wall mounted and floor/ceiling mounted) can be turned 180° to direct the flow into the room or towards the wall on which the unit is mounted. The grids and the side doors are snapped into the cabinet. Before removing them in order to change their position, cut the power off and wear protective gloves.

MAINTENANCE

For safety reasons before carrying out any maintenance or cleaning operation, switch off the unit turning the selection switch to "Stop" and the power supply switch on position 0 (OFF).

Be careful during any maintenance operation; you could get injured by some metal parts; use protective work gloves. The fan coils do not require any particular maintenance operation: only the periodical cleaning of the air filter should be carried out. It is necessary to carry out a running in period of 100 hours in order to eliminate all mechanical friction. The starting up must be carried out at the maximum speed.

For good operation of the fan coils follow the instructions below:

- keep the air filter clean;
- do not pour liquids into the unit;
- do not introduce metal parts through the air outlet grid;
- keep the air inlet and outlet free at all times.

Each time the machine is turned on after being idle for a long period, ensure there is no air in the heat exchanger. Before using the unit for air conditions, check that:

- condensate drainage is performed correctly;
- the heat exchanger fins are not obstructed by deposits of dirt.

If necessary clean the fins with low pressure compressed air or steam without damaging them.

CLEANING

For safety reasons before carrying out any maintenance or cleaning operation switch off the unit turning the selection switch to "Stop" and the power supply switch on 0 (OFF).

Clean the filter at least once a month and in any case before using the unit (before the heating or the air conditioning season).

For cleaning the air filter proceed as follows (pictures see manual of units):

- Floor models: turn the screws 90°, which secure the filter to the cover cabinet, to 1/4 turn and remove the filter;
- Concealed models: reach the fan coil through the inspection panel and remove the filter, turning the locking brackets 90°;
- Floor ceiling: remove the air filters that are inside the intake grids located on the front panel of the cover cabinet;
- clean the filter with lukewarm water, or in case of dry dust, with compressed air;
- reassemble the filter after having dried it up

It is recommended to replace the air filter yearly, and to use original spare parts; the fan coil model is reported on the nameplate located on the internal part of the side panel of the unit.

To clean the unit cabinet proceed as follows

- use a soft cloth;
- do not pour any liquid on the unit, as this could cause electrical shocks or damage the components inside it;
- do not use any aggressive chemical solvents; do not use very hot water to clean the air outlet grid

Note: this is only based text and should be combined with manuals for relative pictures and additional information.

4TW60019-3 (Sheet 2/2)



12 Installation

12-2 Installation precautions

12-2-2 FWD

12
12-2

BEFORE THE INSTALLATION

The equipment is to be installed and serviced exclusively by technical personnel who are qualified for using this type of machine, in compliance with the relevant local and national regulations.

On receiving the equipment, check its state ensuring that it was not damaged during transport. Refer to the associated technical sheets for the installation and use instructions of any accessories.

INTENDED CONDITIONS OF USE AND OPERATING LIMITS

No responsibility is assumed if the equipment is installed by unqualified personnel, if it is used improperly or under inadmissible conditions, if maintenance is not performed as envisaged in this manual or if original spare parts are not used. For the operating limits please refer to the appropriate chapter. Any other use is considered improper.

Keep the equipment inside the packing until it is ready to be installed so that dust will not infiltrate.

Air sucked by the equipment must always be filtered. Use, when possible, the specific accessories.

If not used during the winter, drain the water from the system to prevent damage caused by the formation of ice. If antifreeze solutions are used, check the freezing point.

Do not change the internal wiring or other parts of the equipment.

INSTALLATION WARNING:

On the fan coil unit install a switch (IL) and/or all remote controls in a position out of the reach of persons who are in a bathtub or shower.

The FWD units may be installed either in horizontal or vertical position. Check that the desired installation complies with one of the diagrams shown in the installation manual, in which both possible configurations, M or AB, are suitable to work for heating and cooling.

AA (INTAKE IN LINE - DELIVERY IN LINE)

AB (AIR SUCTION AT 90° - AIR OUTLET IN LINE)

CONFIGURATION of the unit

The units are always supplied in AA configuration, but the air intake position may be changed during the installation.

FIXING the unit

Fix the standard unit to the ceiling or wall using at least 4 of the 6 slots;

For horizontal installations (ceiling-mounting) it is advisable to use M8 threaded bars, screw anchors suitable for the machine's weight, and to arrange for the positioning of the machine using 2 M8 bolts and a washer the diameter of which is suitable for

Before tightening the check nut, adjust the closing of the main nut so that the equipment will slant correctly, i.e. for facilitating the discharging of the condensate.

The correct slant is achieved by tilting the intake downwards as compared to the delivery, until a difference in level of about 10 mm is obtained from one end to the other. Make the hydraulic connections with the heat exchanger and, for cooling operations, with the condensate discharge.

Use one of the two drains of the auxiliary tank, visible on the outside of the unit's side panels and vertical condensate discharge.

For vertical installations (wall-mounting), fix the unit so that water may flow out toward the condensate discharge used. A slant equivalent to a difference in level of about 5 mm is enough between the two side panels. The two condensate discharge tubes of the main tank are located inside the side panels and may be accessed through a membrane type passage that should be perforated for passing the discharge tube through it. It is advisable not to remove the aforesaid passage because it prevents the sharp edge of the hole on the side panel from damaging the condensate discharge tube over time.

To connect the unit to the condensate discharge line, use a flexible rubber tube and fix it to the chosen discharge tube (f 3/8") by means of a metal clamp (use the discharge that is located on the hydraulic attachments side). To assist the draining of the condensate, slant the discharge tube downwards by at least 30 mm/m making sure that its entire route is clear and free from bends or blockages.

4TW60229-3 (Sheet 1/4)



12 Installation

12-2 Installation precautions

12 12-2-2 FWD

12-2

A few rules to follow

Carry out the heat exchanger's air exhaust, with pumps stopped, by means of the air valves located adjacent to the attachments of the heat exchanger itself.

When implementing a duct system, it is advisable to place the vibration-damping joints between the ducting and the unit. If you wish to install an electrical resistance module as accessory, the delivery vibration-damping joint should be heat-resistant. The ducting, especially the delivery one, should be insulated with anticondensing material.

Provide an inspection panel adjacent to the equipment for the maintenance and cleaning operations.

Install the control panel on the wall. Choose a position that is easy to access for the setting of the functions and, if contemplated, for the reading of the temperature. Try to avoid positions that are directly exposed to sun rays, or positions subject to direct hot or cold air currents, and do not place obstacles in the way that would prevent the correct reading of the temperature.

ELECTRICAL CONNECTIONS

Carry out the electrical wiring after having turned the power off in compliance with the relevant local and national regulations following the relevant wiring diagram.

Only qualified personnel should carry out the wiring operations.

Each fan coil requires a switch (IL) on the feeder line with a distance of at least 3 mm between the opening contacts, and a suitable safety fuse (F).

Power consumption is shown on the data plate fixed to the unit. Make sure to carefully execute the wiring in function of the combination unit/controller and this according to the correct wiring diagram delivered with every accessory. In order to make the electrical connections you must remove the lower closing panel to access the terminal board. The power cables (power supply and control) must be routed to the terminal board through the membrane passage that is on the side panel of the machine on the side opposite the hydraulic attachments.

WARNING

The COMMON wire of the motor is the WHITE one: if connected incorrectly the motor would be damaged irreparably.

FUNCTIONAL CHECKS

Check that the equipment has been installed so that it guarantees the required slant.

Check that the condensate discharge is not clogged (by rubble deposits, etc.).

Check the seal of the hydraulic connections.

Check that all the wirings are tight (perform the check with voltage OFF).

Make sure air has been purged from the heat exchanger.

Power the equipment and check its working efficiency.

4TW60229-3 (Sheet 2/4)



12 Installation

12-2 Installation precautions

12-2-3 FWB

12

12-2

BEFORE THE INSTALLATION

The equipment is to be installed and serviced exclusively by technical personnel who are qualified for using this type of machine, in compliance with the relevant local and national regulations.

On receiving the equipment, check its state ensuring that it was not damaged during transport. Refer to the associated technical sheets for the installation and use instructions of any accessories.

INTENDED CONDITIONS OF USE AND OPERATING LIMITS

No responsibility is assumed if the equipment is installed by unqualified personnel, if it is used improperly or under inadmissible conditions, if maintenance is not performed as envisaged in this manual or if original spare parts are not used. For the operating limits please refer to the appropriate chapter. Any other use is considered improper.

Keep the equipment inside the packing until it is ready to be installed so that dust will not infiltrate.

Air sucked by the equipment must always be filtered. Use, when possible, the specific accessories.

If not used during the winter, drain the water from the system to prevent damage caused by the formation of ice. If antifreeze solutions are used, check the freezing point.

Do not change the internal wiring or other parts of the equipment.

INSTALLATION WARNING:

On the fan coil unit install a switch (IL) and/or all remote controls in a position out of the reach of persons who are in a bathtub or shower.

The FWD units may be installed either in horizontal or vertical position. Check that the desired installation complies with one of the diagrams shown in the installation manual, in which both possible configurations, M or AB, are suitable to work for heating and cooling.

FIXING the unit

Fix the standard unit to the ceiling or wall using at least 4 of the 6 slots;

For horizontal installations (ceiling-mounting) it is advisable to use M8 threaded bars, screw anchors suitable for the machine's weight, and to arrange for the positioning of the machine using 2 M8 bolts and a washer the diameter of which is suitable for

Before tightening the check nut, adjust the closing of the main nut so that the equipment will slant correctly, i.e. for facilitating the discharging of the condensate.

The correct slant is achieved by tilting the intake downwards as compared to the delivery, until a difference in level of about 10 mm is obtained from one end to the other. Make the hydraulic connections with the heat exchanger and, for cooling operations, with the condensate discharge.

Use one of the two drains of the auxiliary tank, visible on the outside of the unit's side panels and vertical condensate discharge.

4TW60299-3 (Sheet 1/2)



12 Installation

12-2 Installation precautions

12 12-2-3 FWB

12-2

A few rules to follow

Carry out the heat exchanger's air exhaust, with pumps stopped, by means of the air valves located adjacent to the attachments of the heat exchanger itself.

When implementing a duct system, it is advisable to place the vibration-damping joints between the ducting and the unit. If you wish to install an electrical resistance module as accessory, the delivery vibration-damping joint should be heat-resistant. The ducting, especially the delivery one, should be insulated with anticondensing material.

Provide an inspection panel adjacent to the equipment for the maintenance and cleaning operations.

Install the control panel on the wall. Choose a position that is easy to access for the setting of the functions and, if contemplated, for the reading of the temperature. Try to avoid positions that are directly exposed to sun rays, or positions subject to direct hot or cold air currents, and do not place obstacles in the way that would prevent the correct reading of the temperature.

ELECTRICAL CONNECTIONS

Carry out the electrical wiring after having turned the power off in compliance with the relevant local and national regulations following the relevant wiring diagram.

Only qualified personnel should carry out the wiring operations.

Each fan coil requires a switch (IL) on the feeder line with a distance of at least 3 mm between the opening contacts, and a suitable safety fuse (F).

Power consumption is shown on the data plate fixed to the unit. Make sure to carefully execute the wiring in function of the combination unit/controller and this according to the correct wiring diagram delivered with every accessory. In order to make the electrical connections you must remove the lower closing panel to access the terminal board. The power cables (power supply and control) must be routed to the terminal board through the membrane passage that is on the side panel of the machine on the side opposite the hydraulic attachments.

WARNING

The COMMON wire of the motor is the WHITE one: if connected incorrectly the motor would be damaged irreparably.

FUNCTIONAL CHECKS

Check that the equipment has been installed so that it guarantees the required slant.

Check that the condensate discharge is not clogged (by rubble deposits, etc.).

Check the seal of the hydraulic connections.

Check that all the wirings are tight (perform the check with voltage OFF).

Make sure air has been purged from the heat exchanger.

Power the equipment and check its working efficiency.

4TW60229-3 (Sheet 2/4)



12 Installation

12-3 Installation & service distance

12-3-1 FWD


12

12-3

1. Ducted unit with filter only

Consider at least:

- 500 mm free space on water connections side (piping & connections)
- 200 mm free space on the opposite side (to unscrew heat exchangers or fan deck in case of repairing)
- Possibility to extract filter for cleaning has to be considered
- Possibility to reach the unit for ordinary and extraordinary maintenance (for instance removing front panels) has to be considered

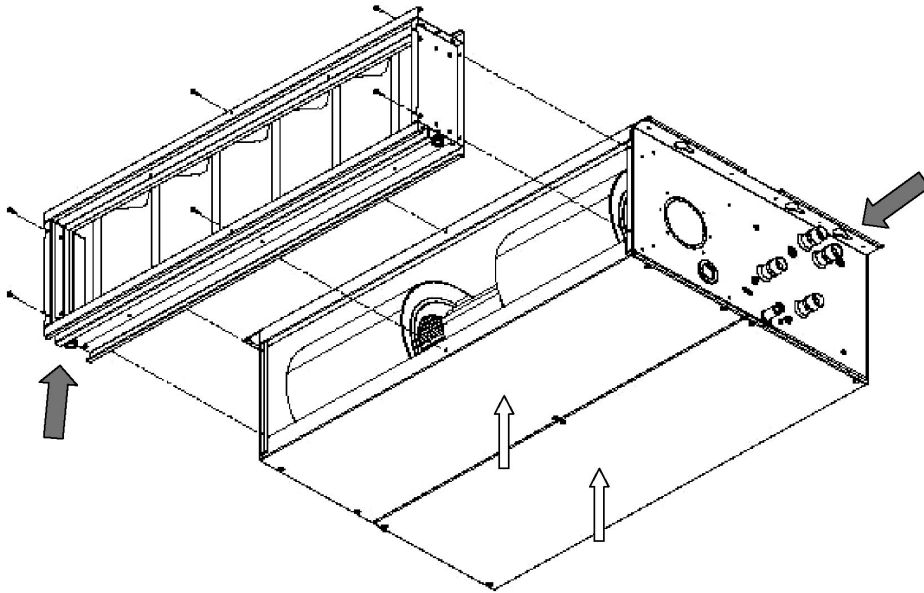

4TW60229-3 (Sheet 3/4)

2. Ducted unit with filter and electric heater

Consider also:


- 500 mm free space on water connections side (piping & connections), measured from the electrical box of the heating module (refer to option technical leaflet for details - total 620 mm)
- 200 mm free space on the opposite side (to unscrew heat exchangers or fan deck in case of repairing)
- Possibility to extract filter for cleaning has to be considered
- Possibility to reach the unit for ordinary and extraordinary maintenance (for instance removing front panels) has to be considered



12 Installation

12-3 Installation & service distance


12-3-1 FWD

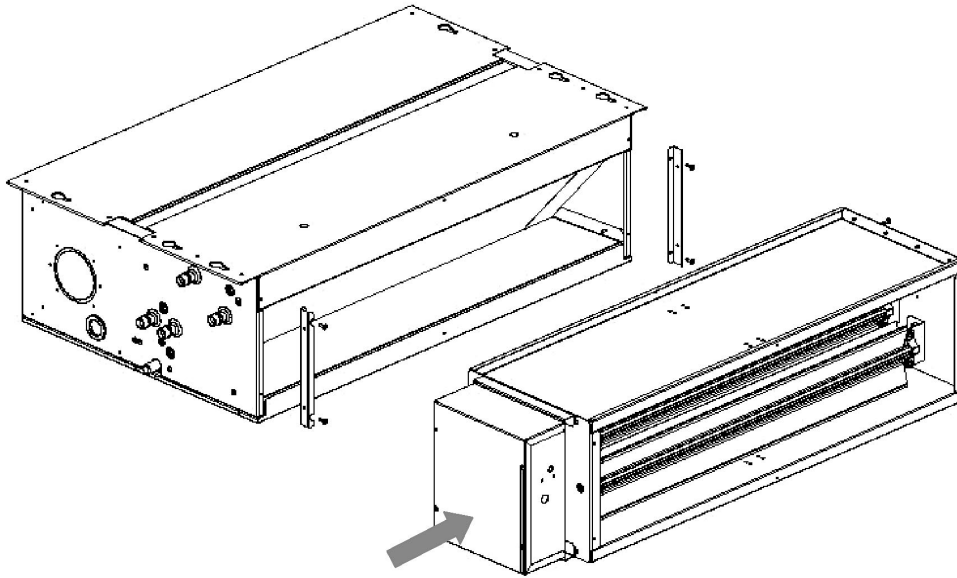

3. Ducted unit with filter and valves

Consider also:

- 500 mm free space on water connections side (piping & connections), measured from the valve piping (refer to option technical leaflet for details - total around 720 mm)
- 200 mm free space on the opposite side (to unscrew heat exchangers or fan deck in case of repairing)
- Possibility to extract filter for cleaning has to be considered
- Possibility to reach the unit for ordinary and extraordinary maintenance (for instance removing front panels) has to be considered

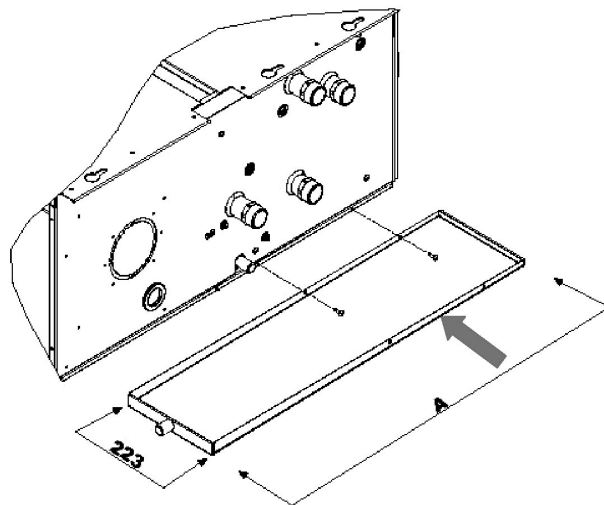



13 Options

13-1 FWV / FWL / FWM

13-1-1 Option list

	Description	Reference	01	02	03	04	06	08	10	FWV	FWL	FWM	Factory mounted	Kit	Notes/remarks	
	Additional single-row heat exchanger	ESRH.A6	ESRH02A6		ESRH03A6	ESRH06A6		ESRH10A6		X	X	X	X	X	Cannot be used in combination with electric heater	
	Electric heater	EEH.A6	EEH01A6	EEH02A6	EEH03A6	EEH06A6		EEH10A6		X	X	X	X(*)	X	Cannot be used in combination with additional H/E requires electronic controller	
	2-pipe ON-OFF 3 way motor driven valve complete with mounting kit pre-assembled	E2MV.A6	E2MV03A6			E2MV06A6		E2MV10A6		X	X	X	X	X	Requires electronic controller or electromechanical controller	
	4-pipe ON-OFF 3 way motor driven valve complete with mounting kit pre-assembled	E4MV.A6	E4MV03A6			E4MV06A6		E4MV10A6		X	X	X	X(*)	X	Requires electronic controller	
	Fan stop thermostat	YFSTA6	YFSTA6							X	X	X	X(*)	X		
	Air intake & discharge grill + front filter fixing kit for concealed models	EAI DF.A6	EAI DF02A6	EAI DF03A6	EAI DF06A6		EAI DF10A6					X	-	X		
	Supporting feet (= supporting brackets + covers)	ESFV.A6	ESFV06A6					ESFV10A6		X		X	-	X	Covers cannot be used for FWM	
	Supporting feet + grill	ESFVG.A6	ESFVG02A6	ESFVG03A6	ESFVG06A6		ESFVG10A6		X				-	X		
	Fresh air intake louvers (manual)	EFA.A6	EFA02A6	EFA3A6	EFA6A6		EFA10A6		X				-	X		
	Rear panel for vertical mounted models	ERP.V.A6	ERP.V2A6	ERP.V03A6	ERP.V06A6		ERP.V10A6		X	X			-	X	Only for vertical mounted units	
	Controller electro mechanical built in	ECFWM.B6	ECFWM.B6							X	X	X	X(*)	X		
	Controller electrical built in + water probe	ECFWE.B6	ECFWE.B6							X	X	X	X(*)	X	In combination with FWV / FWL / FWM10, EPIMSA6 must be installed	
	Controller electrical remote + water probe	ECFWER6	ECFWER6							X	X	X	-	X		
	Master / Slave Interface	EPIMSA6	EPIMSA6							X	X	X	X	X		
	Vertical drain pan	EDP.VA6	EDP.VA6							X	X	X	-	X		
	Horizontal drain pan	EDP.HA6	EDP.HA6									X	X	-	X	

NOTES

X: available X(*): only possible as factory mounted on special order request -: not available

4TW60019-2A (Sheet 1/2)



13-1

13

13 Options

13-1 FWV / FWL / FWM

86

DAIKIN

DAIKIN

13-1-2 Cross reference table

		Additional single-row heat exchanger	Electric heater	2-pipe ON-OFF 3 way motor driven valve complete with mounting kit	4-pipe ON-OFF 3 way motor driven valve complete with mounting kit	Fan stop thermostat	Air intake & discharge grill + front filter fixing kit for concealed models	Supporting feet feet (= supporting brackets + covers)	Supporting feet + grill	Fresh air intake louvers (manual)	Rear panel for vertical mounted models	Controller electro mechanical built in	Controller electrical built in	Controller electrical remote + water probe	Master / Slave Interface	Vertical drain pan	Horizontal drain pan
		ESRH.A6	EEH.A6	E2MV.A6	E4MV.A6	YFSTA6	EAI DF.A6	ESFV.A6	ESFVG.A6	EFA.A6	ERP.V.A6	ECFWM.B6	ECFWE.B6	ECFWE.R6	EPIM.SA6	EDPVA6	EDPHA6
Additional single-row heat exchanger	ESRH.A6				X		X	X	X	X	X		X	X	X	X	X
Electric heater	EEH.A6			X			X	X	X	X	X		X	X	X	X	X
2-pipe ON-OFF 3 way motor driven valve complete with mounting kit	E2MV.A6		X				X	X	X	X	X	X	X	X	X	X	X
4-pipe ON-OFF 3 way motor driven valve complete with mounting kit	E4MV.A6	X					X	X	X	X	X		X	X	X	X	X
Fan stop thermostat	YFSTA6						X	X	X	X	X	X			X	X	X
Air intake & discharge grill + front filter fixing kit for concealed models	EAI DF.A6	X	X	X	X	X		X	X	X				X	X	X	X
Supporting feet feet (= supporting brackets + covers)	ESFV.A6	X	X	X	X	X	X			X	X	X	X	X	X	X	X
Supporting feet + grill	ESFVG.A6	X	X	X	X	X	X			X	X	X	X	X	X	X	X
Fresh air intake louvers (manual)	EFA.A6	X	X	X	X	X		X	X		X	X	X	X	X	X	X
Rear panel for vertical mounted models	ERP.V.A6	X	X	X	X	X	X	X	X	X		X	X	X	X	X	X
Controller electro mechanical built in	ECFWM.B6			X		X		X	X	X	X				X	x	X
Controller electrical built in	ECFWE.B6	X	X	X	X			X	X	X	X				X	X	X
Controller electrical remote + water probe	ECFWE.R6	X	X	X	X		X	X	X	X	X				X	X	X
Master / Slave Interface	EPIM.SA6	X	X	X	X	X	X	X	X	X	X	X	X	X		X	X
Vertical drain pan	EDPVA6	X	X	X	X		X	X	X	X	X				X	X	X
Horizontal drain pan	EDPHA6	X	X	X	X	X	X	X	X	X	X	X	X	X		x	X

4TW60019-2A (Sheet 2/2)



13 Options

13-2 FWD

13-2-1 Option list

	Description	Reference	04	06	08	10	12	16	18	Factory mounted	Kit	Notes/remarks	
	Electric heater: small	EDEH(S)A6	EDEH04A6	EDEHS06A6	EDEHS10A6		EDEHS12A6	EDEHS18A6		-	X	Requires electronic controller	
	Electric heater: big	EDEH(B)A6	EDEH04A6	EDEHB06A6	EDEHB10A6		EDEHB12A6	EDEHB18A6		-	X		
	2-pipe 3-way valve	ED2MV_A6	ED2MV04A6	ED2MV10A6			ED2MV12A6	ED2MV18A6		-	X	For FWD12-16-18 only motor valve (piping not included)	
	4-pipe 3-way valve	ED4MV_A6	ED4MV04A6	ED4MV10A6			2 x ED2MV12A6	2 x ED2MV18A6		-	X		
	Drain pan	EDDPV_A6	EDDPV10A6				EDDPV18A6			-	X		
	Fan stop thermostat	YFSTA6	YFSTA6							-	X		
	Fresh air intake louvers (motorised)	EDMFA_A6	EDMFA04A6	EDMFA06A6	EDMFA10A6		EDMFA12A6	EDMFA18A6		-	X		
	Controller electrical remote + water probe	ECFWER6	ECFWER6							-	X	Neglecting the absolute requirement to install an additional interface (EPIA6 or EPIMSA6) to FWD06→18 may cause fire or other damage to the equipment	
	Master / Slave Interface	EPIMSA6	EPIMSA6				-	-	-		-	X	In combination with ECFWER6, EPIMSA6 or EPIA6 must be installed for FWD12-16-18
	Power interface	EPIA6	-	EPIA6					-		-	X	In combination with ECFWER6, EPIA6 must be installed for FWD12-16-18

4TW60229-2 (Sheet 1/2)

13 Options

13-2 FWD



13-2

13

13-2-2 Cross reference table

		Electric heater: small	Electric heater: big	2-pipe 3-way valve	4-pipe 3-way valve	Fan stop thermostat	Motorised fresh air intake	Controller electronic - remote	Drain pan (vertical models)	Master / Slave Interface	Power interface
Description		EDEH(S).A6	EDEH(B).A6	ED2MV.A6	ED4MV.A6	YFSTA6	EDMFA.A6	ECFWDER6	EDDPV.A6	EPIMSA6	EPIA6
Electric heater: small	EDEH(S).A6		X	X			X	X	X	X	X
Electric heater: big	EDEH(B).A6		X	X			X	X	X	X	X
2-pipe 3-way valve	ED2MV.A6	X					X	X	X	X	X
4-pipe 3-way valve	ED4MV.A6						X	X	X	X	X
Fan stop thermostat	YFSTA6						X				
Motorised fresh air intake	EDMFA.A6	X	X	X	X	X		X	X	X	X
Controller electronic - remote	ECFWER6	X	X	X	X		X		X	X	X
Drain pan (vertical & horizontal models)	EDDPV.A6	X	X	X	X		X		X	X	X
Drain pan (vertical models)	EDDPV.A6	X	X	X	X		X	X			
Master / Slave Interface	EPIMSA6	X	X	X	X		X	X			
Power interface	EPIA6	X	X	X	X		X	X			





4TW60229-2 (Sheet 2/2)



13 Options

13-3 FWB

13-3-1 Option list

Description	02	03	04	05	06	07	08	09	10	Comments	
Additional heat exchanger	EAH04A6		EAH07A6			EAH10A6					
3-way valve add. h/e	E2MV307A6				E2MV310A6					No insulation needed	
2-way valve add. h/e	E2MV207A6				E2MC210A6						
 Fan stop thermostat	YFSTA6										Same as other model
 Power interface	-	-	-	EPIA6							In combination with ECFWER6, EPIMSA6 or EPIA6 must be installed for FWBOS-10
 Master slave interface	EPIMSA6										
 Controller electronic - remote	ECFWER6										

4TW60229-2 (Sheet 1/2)

13 Options

13-3 FWB



13-3

13

13-3-2 Cross reference table

Description		Additional heat exchanger	3-way valve add. h/e	2-way valve add. h/e	Fan stop thermostat	Power interface	Master slave interface	Controller electronic - remote	Controller electronic - M/S
		EAH.A6	E2MV3.A6	E2MV2.A6	YFSTA6	EPIA6	EPIMSA6	ECFVER6	ECPWEMS6
Additional heat exchanger	EAH.A6		X	X	X*	X	X	X	X
3-way valve add. h/e	E2MV3.A6	X				X	X	X	X
2-way valve add. h/e	E2MV2.A6	X				X	X		
Fan stop thermostat	YFSTA6					X	X*		
Power interface	EPIA6	X	X	X	X			X	X
Master slave interface	EPIMSA6	X	X					X	X
Controller electronic - remote	ECFVER6	X	X			X	X		
Controller electronic - M/S	ECPWEMS6	X	X			X	X		

4TW60229-2 (Sheet 2/2)